



Project no.:
608540

Project acronym:
GARPUR

Project full title:
**Generally Accepted Reliability Principle with
Uncertainty modelling and through probabilistic Risk assessment**

Collaborative project

FP7-ENERGY-2013-1

Start date of project: 2013-09-01
Duration: 4 years

D8.1
**Pilot testing methodologies, models, scenarios
and validation approach**

Due delivery date: 2016-02-29
Actual delivery date: 2016-02-18

Organisation name of lead beneficiary for this deliverable:
NTNU Norwegian University of Science and Technology

Project co-funded by the European Commission within the Seventh Framework Programme (2007-2013)		
Dissemination Level		
PU	Public	X
PP	Restricted to other programme participants (including the Commission Services)	
RE	Restricted to a group specified by the consortium (including the Commission Services)	
CO	Confidential , only for members of the consortium (including the Commission Services)	

Deliverable number:	D8.1
Deliverable short title:	Pilot testing methodologies, models, scenarios and validation approach
Deliverable title in DoW:	Report describing pilot testing methodologies, models, scenarios and validation approach
Work package:	WP8 Pilot Scale Validation
Lead participant:	NTNU

Revision Control			
Date	Revision	Author(s)	Comments

Quality Assurance, status of deliverable		
Action	Performed by	Date
Verified (WP leader)	Matthias Hofmann (STATNETT)	2016-02-18
Reviewed (Sc. Advisor)	Louis Wehenkel (ULG)	2016-03-15
Approved (EB)	EB17	2016-04-08
Approved (Coordinator)	Oddbjørn Gjerde (SINTEF)	2016-04-15

Submitted		
Author(s) Name	Organisation	E-mail
Camille Hamon	NTNU	camille.hamon@ntnu.no
Nikolay Nikolaev	ESO	n.nikolaev86@gmail.com
Andrey Andreev	ESO	aandreev@ndc.bg
Nenko Gamov	ESO	ngamov@ndc.bg
Ventsislav Zahov	ESO	vzahov@ndc.bg
Boyko Chovikov	ESO	bchovikov@ndc.bg
Samuel Perkin	Landsnet	samuelp@landsnet.is
Guðjón Hugberg Björnsson	Landsnet	gudjonh@landsnet.is
Arnaud Vergnol	ELIA	arnaud.vergnol@elia.be
Jonathan Sprooten	ELIA	jonathan.sprooten@eliagrid-int.com
Waquas Bukhsh	Strathclyde	waquas.bukhsh@strath.ac.uk
Pascal Tournebise	RTE	remy.clement@rte-france.com
Rémy Clement	RTE	pascal.tournebise@rte-france.com
Karel Máslo	ČEPS	maslo@ceps.cz
Oldřich Rychlý	ČEPS	rychly@ceps.cz
Evelyn Heylen	KU Leuven	evelyn.heylen@esat.kuleuven.be
Matthias Hofmann	STATNETT	matthias.hofmann@statnett.no
Leif Warland	STATNETT	leif.warland@statnett.no

Table of Contents

	Page
EXECUTIVE SUMMARY	9
1 INTRODUCTION	11
1.1 Overview of WP8	11
1.2 Links to other work packages	12
1.3 Scope of this report	13
1.4 Report structure	13
2 DESCRIPTION OF THE PILOT TESTS.....	14
2.1 Overview of the pilot tests	14
2.2 Pilot tests in Task 8.3	14
2.3 Pilot tests in Task 8.4	16
2.4 Priority list.....	20
3 TESTING METHODS AND CRITERIA	21
3.1 General workflow for the pilot tests	21
3.2 Workflow for pilot test 8.3.1 (RTE).....	21
3.3 Workflow for pilot test 8.4.1 (Landsnet)	27
3.4 Workflow for pilot test 8.4.3 (Elia)	29
4 METHODOLOGY FOR THE ASSESSMENTS OF PILOT TESTS.....	38
4.1 Assessment as proposed by the theoretic work of GARPUR.....	38
4.2 Assessment as proposed by the pilot tests	40
4.3 Assessment metrics available in the GQP-prototype	41
5 CONCLUSIONS	43
6 APPENDIX	44
6.1 Workflow for pilot test 8.3.3 (ČEPS)	44
6.2 Workflow for pilot test 8.4.5 (ESO).....	46
7 REFERENCES	48

Table of Figures

	Page
Figure 1: Workflow of WP8	11
Figure 2: General workflow for the pilot tests.	21
Figure 3: Graphical convention used throughout the description of RTE's pilot test T8.3.1.	22
Figure 4: Concepts of risk evaluation zone and contingency and remedial action zone.	23
Figure 5: General flowchart of RTE's pilot test 8.3.1.	23
Figure 6: Details on the day-ahead and real-time processes.	24
Figure 7: Creation of the real-time snapshots.	24
Figure 8: Contingency simulation.	25
Figure 9: Preventive and corrective actions.	25
Figure 10: Multilevel optimisation problem, coupling between preventive and corrective actions and concept of acceptable states.	26
Figure 11: Workflow diagram of the RT near real-life pilot test at Landsnet. The models shown as stacks identify those which must be run for each credible contingency.	27
Figure 12: Pilot test to compare the GARPUR methodology and Current Elia's Multi-state Approach.	30
Figure 13: Flowchart of ČEPS' pilot test.	45
Figure 14: Workflow diagram for ESO's pilot test	46

Table of Tables

	Page
Table 1: Overview of the pilot tests	14
Table 2: Voltage acceptability constraints.	32
Table 3: Overload acceptability constraints.	32
Table 4: Short-circuit power acceptability constraints.	33
Table 5: System behaviour.	35

List of symbols

CEE	Central Eastern Europe
CENS	Expected cost of energy not supplied
DACF	Day-ahead congestion forecast
DC-LF	Direct-current load-flow
DoW	Description of work
ENS	Expected energy not supplied
GQP	GARPUR quantification platform
LT	Long-term
RES	Renewable energy sources
RMAC	Reliability management approach and criterion
RT	Real-time
SNP	Snapshot
ST	Short-term
TSO	Transmission system operator
TYNDP	Ten-Year Network Development Plan
WP	Work package

EXECUTIVE SUMMARY

This report describes the pilot tests that will be carried out within GARPUR. The pilot tests aim at assessing and validating, as closely as possible to real-life conditions, the new Reliability Management Approach and Criteria (RMACs) developed in work package 2 and the socio-economic impact assessment framework developed in work package 3, while considering the methodologies and approaches for practical implementation in work packages 4, 5 and 6. The proposed RMACs are compared against the current N-1 practices and approaches determined in work package 1. In addition, some pilot tests will make use of the GARPUR Quantification Platform (GQP) that has been developed by work package 7.

A total of eight pilot tests are proposed by five different transmission system operators (TSOs) and given different priority levels for implementation. Three pilot tests make use of the GQP. The five other pilot tests will be implemented at TSOs' premises in near real-life context. The pilot tests cover real-time operations, short-term operation planning and long-term system development. Different indicators are proposed to assess the proposed reliability management approach and criteria and compare them with current practices. The diversity of the pilot tests in terms of time horizons and the number of involved TSOs demonstrate the general nature of the reliability management approach and criteria proposed within GARPUR.

1 INTRODUCTION

1.1 Overview of WP8

This report is the result of the first task, task 8.1, in work package 8 (WP8). The two objectives of WP8, as recalled from the GARPUR Description of Work (DoW) [GARPUR, 2013], are:

- Objective 1:** *To validate the possibility to compare different reliability criteria in terms of their induced socio-economic consequences: Convincing and scientifically valid arguments are provided when choosing new criteria which circumvent the limitations of N-1. This is done by using the quantification platform prototype on one or possibly several test scenarios, relevant primarily at the pan-European level. This allows for credible proposals of new families of criteria to be considered in the future operation and planning of the EPS. Therefore we have PILOT tests using the quantification platform prototype.*
- Objective 2:** *To validate the practicalities of incorporating such new families of criteria into a TSOs actual decision making processes. This is done by choosing a TSO, and one or several decision making contexts (e.g., real-time operation and long-term planning). A pilot test runs a selected set of reliability management applications using the new criterion with actual system data, and evaluates decisions within the particular system and context(s). Therefore we have PILOT tests of the practical use of new reliability criteria.*

The WP8 of the GARPUR project is divided into 4 tasks. The first task (T8.1) deals with building a systematic process for running the pilot tests. The next task, T8.2, will focus on the specific details of individual tasks e.g. gathering data and making sure adequate software implementations are in place. The pilot tests will be run in the tasks T8.3 and T8.4. In this deliverable, a step-by-step process that the subsequent tasks could follow is proposed. More importantly, through this deliverable, a clear link (agreement) between involved TSOs and academic partners for collaboration is established. Furthermore, the delegation of the responsibilities of running, documenting and reporting of the pilot test to the involved partners is defined.

Objective 1 is dealt with by running pilot tests in Task 8.3, whereas Objective 2 is addressed by running pilot tests in Task 8.4. Figure 1 illustrates the division of work between the different tasks of WP8.

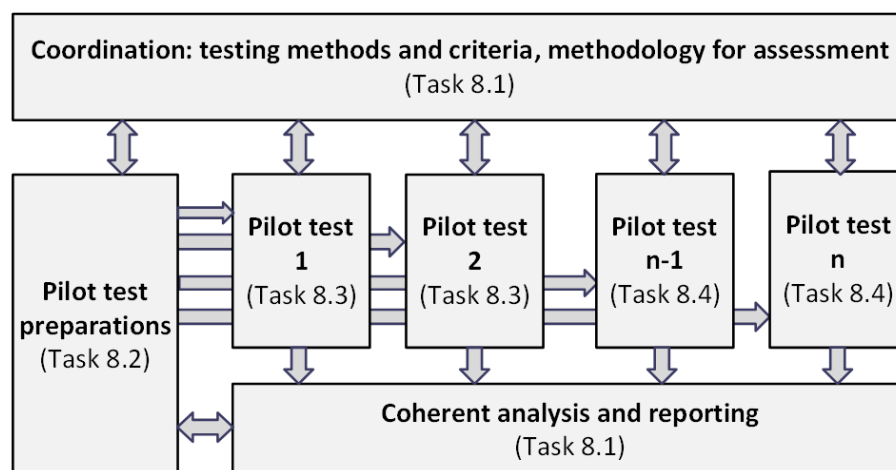


Figure 1: Workflow of WP8

More specifically, from the DoW, the work in Task 8.1 should include:

- **Development of testing methods and criteria.** *A systematic methodology for execution of pilot tests will be established that guarantees consistency regardless of the operational region or time horizon. This includes the choice of test scenarios (power system model, context, etc), the definition of testing procedure and data needs. Available input from WPs 4 – 6 will be taken into account in the development of testing methods and criteria to ensure realism in the testing from a TSO point of view.*

This part of the work corresponds to identifying the pilot tests to be run in Figure 1 and, for each pilot test, the testing procedures to carry out.

- **Establishment of a systematic methodology for the assessment of pilot tests.** *The different metrics for this assessment need to be defined and their use to benchmark/rank different criteria must be specified. The quantification platform prototype must be able to compute a subset among these metrics.*

This part of the work corresponds to, for each pilot test, (i) defining the set of metrics of interest for each pilot test and each Reliability Management Approach and Criterion (RMAC) and (ii) defining the methods used to compile and analyse all sets of metrics obtained from the different RMACs within each pilot test. It therefore also defines the set of compiled results from the pilot tests.

- **Development of a method to assemble and analyse results from different pilot tests.** *To provide coherent methods for analysis in documenting, harmonizing and comparing the results from multiple pilot tests that cover different time horizons. This will also primarily be done by the quantification platform.*

This part of the work corresponds to defining methods for compiling and analysing the results from all pilot tests (“Coherent analysis and reporting” in Figure 1).

We note that the number of tested RMACs is a pilot test specific value, since different pilot tests typically test different decision making contexts and problems. Furthermore, the number of metrics is specific to a pair (*pilot test, RMAC*) since different RMACs are typically based on different pieces of information (for example, the notion of residual risk is not explicitly taken into account in the N-1 criterion).

1.2 Links to other work packages

The pilot tests must consider the inputs from all relevant work packages:

- WP2: A general RMAC formulation is proposed. At the time of writing, WP2 has made proposals for RMAC formulations for assessment and control for long-term grid development, mid-term asset management, short-term operation planning and real-time operations. Parallel to the completion of the present report, WP2 works on developing tractable approximations for the proposals. Furthermore, coherence with respect to the socio-economic analysis made in WP3 and the practical needs defined in WP4, WP5, and WP6 is being made in WP2, to be completed later in the project.
- WP3: A socio-economic impact assessment framework is developed in WP3. It is an important part of the pilot tests since some of the indicators included in the RMAC formulations and used to compare different RMACs are socio-economic indicators. A first proposal is being studied in parallel with the work in WP8. The full tractable socio-economic analysis framework will be ready later in the project.

- WP4/5/6: The RMAC formulations and socio-economic analysis framework proposed in WP2 and WP3 should be acceptable for and usable by Transmission System Operators (TSOs). Parallel to the work in WP8, work packages 4, 5 and 6 are working on developing appropriate formulations.
- WP7: The first prototype of the GARPUR quantification platform is being developed in parallel with the work in WP8.

1.3 Scope of this report

Given the work that is ongoing in other work packages, the main task of T8.1 is to prepare the pilot tests by describing, with as much detail as possible, the required data and tools and the expected outputs. The pilot tests that will be carried out in T8.3 will use the GQP. For these pilot tests, an important part of the preparation is to coordinate with WP7 to reach an agreement on which GQP features will be available.

As described in this report, task T8.1 has covered the following points to prepare the pilot tests. First, an agreement between the academic partners and the TSOs has been established to define the collaboration in the pilot tests. This is important since the pilot tests are driven by TSOs, who may not have the resources to carry out the pilot tests on their own. On the other hand, confidentiality issues limit the extent to which external partners can contribute. Second, pilot tests have been given priority levels so as to use the resources allocated to work package 8 in the most appropriate way. Third, detailed initial proposals of step-by-step processes for implementing the pilot tests with the highest priority level have been developed. The pilot tests with lower priority levels are described with less detail.

1.4 Report structure

In Chapter 2, all proposed pilot tests are briefly described and a priority list for their implementation is proposed. In Chapter 3, the pilot tests with priority level 1 are described in greater detail. In Chapter 4, the indicators and metrics used to compare different reliability criteria are presented. Suggestions for the workflows for the pilot tests with priority level 2 are given in Appendix.

2 DESCRIPTION OF THE PILOT TESTS

This chapter gives a brief description of the proposed pilot tests.

2.1 Overview of the pilot tests

The pilot tests are concerned with assessing the new reliability and socio-economic criteria. The TSOs do this evaluation using the current deterministic criteria as part of their day-to-day job. Moreover the TSOs have access to real network, reliability and historic data that is an essential part of the analysis in pilot tests. In this context, it is proposed that the pilot tests should be led by the TSOs. There are 5 TSOs and 4 academic partners involved in WP8. Table 1 lists all the eight proposed pilot tests, the involved transmission system operators and the considered time horizons (RT=real-time operations, ST=short-term operation planning and LT = long-term system development). The pilot tests in task T8.3 will use the GARPUR quantification platform whereas the pilot tests in task T8.4 will be carried out in near-real life context. All pilot tests are briefly described in Sections 2.2 and 2.3. A priority list for the implementation of the eight pilot tests is given in Section 0.

Table 1: Overview of the pilot tests

Task	Pilot test	TSO	Time horizon
T8.3	Pilot test 8.3.1	RTE	RT+ST
T8.3	Pilot test 8.3.2	RTE	RT+ST
T8.3	Pilot test 8.3.3	ČEPS	RT+ST
T8.4	Pilot test 8.4.1	Landsnet	RT
T8.4	Pilot test 8.4.2	Landsnet	LT
T8.4	Pilot test 8.4.3	Elia	LT
T8.4	Pilot test 8.4.4	Elia	RT
T8.4	Pilot test 8.4.5	ESO	RT+ST

2.2 Pilot tests in Task 8.3

2.2.1 Ambitions of pilot testing in Task 8.3

The objective of pilot testing in Task 8.3 is to validate the possibility to compare different reliability criteria in terms of the socio-economic impacts of their implementation.

The pilot tests in Task 8.3 will be performed by RTE and ČEPS, aiming at using the GQP prototype in order to compare the N-1 strategy with the new probabilistic Reliability Management Approaches and Criteria (RMACs) proposed in WP2, while using the socio-economic impact assessment methodology proposed in WP3.

They will be performed on realistic networks and realistic data, even though only a few control variables may be computed by the GQP, while most of the network remains passive from a risk analysis point of view. The physical models and data for the tests are expected to concern only the steady-state behaviour of the power system.

The pilot tests in the task 8.3 prioritize short-term operation, and will take the following two forms:

- Pilot test 8.3.1 and 8.3.3 (RTE): Analyses on historical cases, using the new reliability criteria to provide a better understanding of the limitations of the current practices based on the N-1 criterion.
- Pilot test 8.3.2 (ČEPS): Dedicated analyses of specific cases to test how the new reliability criteria influence the TSO's decisions compared to the existing N-1 criterion.

2.2.2 Pilot test 8.3.1 (RTE)

The time frame considered for the modelling of the TSO actions is day-ahead operation planning and intra-day real-time operation. The TSO actions that need to be modelled by the GQP are:

- Actions on the topology
- Actions on the phase-shifting transformers (PST)
- Redispatching
- Load-shedding

In order to have convincing results, we intend to run this test on a significantly large sample of credible scenarios. The test does not claim to reproduce precisely the operator behaviour, but it is assumed that the main differences observed between the different RMACs could be interpreted as meaningful trends, should it be later decided to switch from N-1 to the GARPUR RMAC. Therefore, the test will run on one full year, thus encompassing all the seasonal aspects.

The main test would focus on a sub-part of the RTE network. The French network is by nature very resilient to N-1 contingencies. Therefore, we have decided to concentrate our analysis on the south-east region of France which has been responsible for two third of RTE's internal network congestion costs in 2013 mainly due to two parallel lines forming the so called "Tavel-Realtor Corridor".

Besides, the outcome of the performance assessment of different reliability management schemes depends strongly on several modelling assumptions (e.g. probabilities of contingencies and failure modes used; assumptions about the volumes, durations, and monetization of service interruptions; etc.). Therefore, it is also proposed to perform sensitivity analyses to look at the impact of such assumptions on the outcome of these tests. The lessons learnt from such sensitivity analyses would be greatly valuable for future work and for dissemination activities.

Regarding the GARPUR Quantification Platform (GQP) two elements will be especially challenging:

- The computation problem: regarding the number of computations it will be necessary to proceed to some simplifications without jeopardizing the outcome conclusions,
- The multi-level coupling optimisation problem (see Section 3.2) between the preventive actions (short-term and real-time) and the corrective actions (real-time).

2.2.3 Pilot test 8.3.2 (RTE)

If enough resources are available at the end of the pilot test 8.3.1, RTE will run the same kind of test on the same network in a multi-TSO setup, i.e. instead of the French single-TSO setup. The French network will be artificially split in two, north and south for example.

This test will mimic the situation where there are two TSOs, each one responsible for its own control area. To this end, the reliability management problems (Day-ahead and Intra-day) are first decomposed into 2 sub-problems (one for each TSO), in terms of decision variables and in terms of cost functions and constraints. Then for each TSO, a reliability criterion is postulated (either N-1, or the probabilistic RMAC)

for its own area, in order to compute the corresponding decisions for its area. Notice that this leads in principle to four combinations of strategies (N-1 in both areas, RMAC in both areas, N-1 in either area and RMAC in the other area). Each strategy combination will lead (in the same fashion as for Test 8.3.1) to the assessment of the resulting decisions on the reliability of each area, as well as on the whole system.

2.2.4 Pilot test 8.3.3 (ČEPS)

This pilot test will consider the Central Eastern Europe (CEE) region (Germany, Austria, Poland, Czech republic, Slovakia and Hungary), which often suffers from large loop flows caused by massive export from Northern Germany to the south due to excessive production from the renewable energy sources (RES).

In this context, a situation on 22nd of August 2012 stands out. The grid was stressed due to several reasons e.g. maintenance, summer time – changes in load of grid. The affected TSOs were PSE-O, APG, ČEPS and 50Hertz. The main reasons of the stressed situation were high flows from north to south in the CEE region due to high export of RES production from Germany, especially the concurrence of production of photovoltaics and wind power plants together with high import into Austria and far to the CEE region. On that day, the grid was weakened due to maintenance works on lines and equipment, and also due to maintenance of power plants, and some lines were overloaded. During the day-ahead congestion forecast (DACF) process several N-1 violations were detected and remedial actions like topological measures, re-dispatch via HVDC links and re-dispatch of generating units were derived.

The pilot test 8.3.3 deals with the issues related to the power flows in the CEE region. This situation is particularly important for ČEPS because it creates many problems in the electrical network and endangers stability and reliability. ČEPS expects that the pilot test case will allow investigating whether the proposed RMAC could be relevant for replacement of the current N-1 reliability criterion.

The test case will be focused on comparing the current (N-1 based) and alternative (probabilistic) reliability criteria. The range of CEE grid is circa 1500 nodes (at snapshots). In the DACF process, data of the whole grid with 21 TSOs (9500 nodes) is used, corresponding to almost the whole pan European grid. The following is a high-level summary of the proposed pilot test:

- **Time frame:** Real time to day ahead (short term).
- **Period of Assessment:** One day (especially the part of the day when large loop flows stressed the CEE grid).
- **Assessment type:** Assessment of risk, optimization of preventive actions.

2.3 Pilot tests in Task 8.4

2.3.1 Ambitions of pilot testing in Task 8.4

The objective of pilot testing in Task 8.4 is to validate the practicality of applying the new reliability management approach and criterion in a near real-life context. This relates to:

- i) Defining pilot tests of the new reliability criteria that are practically feasible given present day TSO practices;
- ii) Creating new tools and models, or making reasonable assumptions, to provide the necessary input data for the pilot tests;
- iii) Performing the pilot tests defined in point (i);
- iv) Evaluate the outcomes of the pilot tests by comparison with existing TSO procedures and the N-1 criterion.

These pilot tests will be performed in both low and high complexity systems. Landsnet's system is considered as a low complexity test case, given the lack of cross-border connections, and is relatively smaller than other European sub-systems. The high complexity test cases are the transmission systems of Elia and ESO, which are both larger and heavily interconnected to other European countries, with meshed networks and active markets.

The outcome of these tests will give an indication of the degree to which the new reliability management approach and criteria can be applied in practice. The tests will also provide an indication on where future research should concentrate its efforts, in terms of tools, data gathering and modelling, to best facilitate the migration of TSOs toward the proposed probabilistic reliability criteria. However, the proposal of the near-real life pilot tests is neither to validate the accuracy of the probabilistic criteria nor to make a critical comparison to the N-1 criterion in terms of socio-economic impact.

2.3.2 Pilot test 8.4.1 (Landsnet)

Given that Iceland has a small isolated system, it is practical for testing the general performance of the methodology developed in WP2 and further refined in WP6 in terms of tractability and speed. The greatest exogenous source of risk to the Icelandic system is weather, and therefore this will be an important aspect of a test case in Iceland. Of specific interest will be the positioning of spinning reserves, and the setting of transmission limits across the main 'cuts' on the system.

The first round of this pilot test aims to answer the following question: "Can we practically assess the risk in real-time on the Icelandic transmission system using the GARPUR methodology?" This will be a low-complexity application of the GARPUR methodology, as it is anticipated that a simple application will best reflect how TSOs are likely to migrate to the method in the future. This will essentially be a debugging and validation test. It will also answer the question of "Does the output make sense and agree with TSO expectations?" This is anticipated to be an important test as it will also determine whether the method appears as a 'black box' or is immediately understandable by operators.

Assuming that the first stage pilot test is a success, the test will be extended to include an optimization of preventive actions, and possibly dynamic constraints and corrective control actions (while taking into account their failure modes).

- **Time frame:** Real-time to Day Ahead.
- **Period of Assessment:** One day ahead (sampled from an entire year).
- **Assessment type:** First a simple assessment of risk. If results of assessment are acceptable, it will be followed by an optimization of preventive (and possibly corrective) actions.

2.3.3 Pilot test 8.4.2 (Landsnet)

This test is proposed tentatively, depending on the results of the real-time test at Landsnet and the the long-term test at Elia (see Section 2.3.4), and whether the method applied by Elia is applicable in Iceland. The goal of such a test would be to confirm that the GARPUR methodology could be applied in the system development context at different TSOs with minimal adjustments. The rest of this section considers the case where such a test would indeed take place.

Iceland is currently considering a number of grid reinforcement projects that could be assessed by the GARPUR methodology. Specifically this pilot test will transpose the method for the selection of "credible

scenarios” applied at Elia, so as to define credible scenarios for the Icelandic system and assess its potential grid reinforcements. There are two potentially interesting grid reinforcements that could be assessed:

- Reinforcement of radials to make them N-1 compliant: small-scale, somewhat binary decisions, would be interesting to assess the investment from a pure reliability perspective.
- Reinforcing the 132kV ring: A number of candidate decisions have been proposed in the latest Ten-Year Network Development Plan (TYNDP), and would therefore be highly relevant to investigate.

Alternatively, it may be useful to retrospectively assess some alternatives to the 2006 TYNDP by performing a coarse simulation (using historical data) of the system until 2016 to determine how sensitive the GARPUR methodology is to different system development decisions on the Icelandic transmission system. This however would require more work in defining viable development decisions.

- **Time frame:** Long Term.
- **Assessment Period:** 10 years.
- **Assessment type:** Analysis (comparison of alternative system development decisions).

2.3.4 Pilot test 8.4.3 (Elia)

It is proposed to implement part of the concepts, that are proposed by WP2 and WP4, within the existing context of long-term grid planning for the Belgian power system. This test will allow Elia to compare the results obtained using the current approach and the new proposed approach.

At the time of writing of this report, the step “selection of credible operating scenarios” is being considered in WP4. This task is a first step in order to identify the relevant states for which the future grid needs to be designed. This methodology seems mature and feasible to be implemented in the long-term process at Elia.

The current method used by Elia is a *multi-state approach* based on best estimates of forecasted values. It is therefore considered relevant to compare the current approach with the one proposed by GARPUR. In order for this comparison to be made, an implementation of the approach of GARPUR within the software DIgSILENT Powerfactory (which is used within Elia) is needed.

The objectives of the pilot test are therefore to validate the concept proposed by GARPUR for the screening of operating scenarios in a near-real life environment and compare its performance with more conventional approaches implemented in the same environment.

The validation and comparison will cover usability of the new approach, differences and similarities between the new and conventional approach in terms of missing critical scenarios, selection of redundant scenarios and computing time.

Finally, recommendations for improvement of the new approach will be proposed. The following is a brief summary of the proposed pilot test:

- **Time frame:** Long term grid development.
- **Period of Assessment:** One year.
Assessment type: Comparison between proposed approach and currently used approach in real grid development environment and recommendations for further improvement of the proposed approach.

2.3.5 Pilot test 8.4.4 (Elia)

Given the development performed in Landsnet's short-term pilot test 8.4.1 (see Section 2.3.2), an assessment of a reliability criterion following the methodology proposed by Landsnet to evaluate risk in real-time will be implemented. The test will highlight the difference in risk assessment between an interconnected system and an islanded grid.

The assessment of the reliability criterion will be computed on snapshots provided by the EMS system and used, in the context of the test, for post-treatment analysis. Assessment of the results will be done by both system security experts and real-time system engineers (i.e. operators) and will compare potential decisions that would have been taken if the new reliability criterion had been available in real-time with the actual real-time decisions taken. The following is a brief summary of the proposed pilot test:

- **Time frame:** Real-time.
- **Period of Assessment:** At least 2 test periods (each of a few consecutive hours).
- **Assessment type:** First a simple assessment of risk. If results of assessment are acceptable, it will be followed by an optimization of preventive (and possibly corrective) actions.

2.3.6 Pilot test 8.4.5 (ESO)

This pilot test is from the perspective of the short-term planning. The test case will be based on the Bulgarian power system model. The neighbouring TSOs will be represented by bus power injections. The model will include detailed models of the entire 400 and 220 kV grid and only small parts of the 110 kV grid. Generation units are represented using equivalent models up to the high-voltage bus of their step-up transformers. The model comprises about 94 buses and is good to test medium-sized power systems in terms of algorithm scalability and tractability. The data set includes DACF files (day-ahead congestion forecast) for an entire year at a resolution of 1 hour. For some periods snapshots with recorded data are available.

The Bulgarian power system is interesting because its 400 and 220 kV grid is resilient. Congestions and failures are rare and the pilot test will focus on comparing the preventive actions proposed by the new criterion with those proposed by the N-1 criterion.

- **Time frame:** Short-term.
- **Period of Assessment:** One year.
- **Assessment type:** Assessment of risk, and optimization of preventive actions.

2.4 Priority list

Considering the number of proposed pilot tests and the resources available, three priority levels are defined to categorise the pilot tests:

1. Priority 1 tests:
 - a. RTE – RT+ST test 8.3.1
 - b. Landsnet – RT test 8.4.1
 - c. Elia – LT test 8.4.3
2. Priority 2 tests:
 - a. ČEPS – RT+ST test 8.3.3
 - b. ESO – ST test 8.4.5
3. Priority 3 tests:
 - a. RTE – ST test 8.3.2
 - b. Landsnet – LT test 8.4.2
 - c. Elia – RT test 8.4.4

The tests with priority 1 will be started as soon as possible. Based on the experience from starting up the tests with priority 1, the feasibility of performing the tests with priority 2 will be evaluated. Pilot tests with priority 3 will only be done if time and resources are available.

The workflows of the pilot tests with priority 1 are described in greater detail in Chapter 3. Details about the specifications of pilot tests with priority 2 are given in the Appendix.

3 TESTING METHODS AND CRITERIA

In this chapter, a detailed description of the proposed test cases with priority level 1 is given. In Section 3.1, a generic workflow that is common to all pilot tests is presented. In Sections 3.2 to 3.4, detailed specifications of the pilot tests are given.

3.1 General workflow for the pilot tests

The pilot tests in Task 8.3 aim at testing the GARPUR quantification platform (GQP), whereas pilot tests in Task 8.4 do not need to rely only on tools provided by the GQP, as previously described in the objectives 1 and 2 of WP8 (see Section 1.1). Figure 2 illustrates the general workflow that is proposed for the methodology of the pilot tests and shows that it is important to identify the set of additional features that need to be implemented in the GQP, so that Task 8.3 can be completed by only using the GQP. This has been done continuously in cooperation with WP7 during the course of Task T8.1. Figure 2 also shows a distinction between, on the one hand, steps that are specific to the TSOs whose system will be tested and, on the other hand, steps that are specific to the considered pilot test but not to the involved TSOs. This distinction is important to delimit the steps that together define a general “plug-and-play” methodology that can be used by any actor. In Figure 2, the box “Assumptions and simplifications” accounts for the fact that the data provided by the TSOs may not be as comprehensive as what is expected in the general methodology. The box “pre-processing” enables the TSOs to adapt their data to the plug-and-play methodology. Data neutralisation for confidentiality issues is included there.

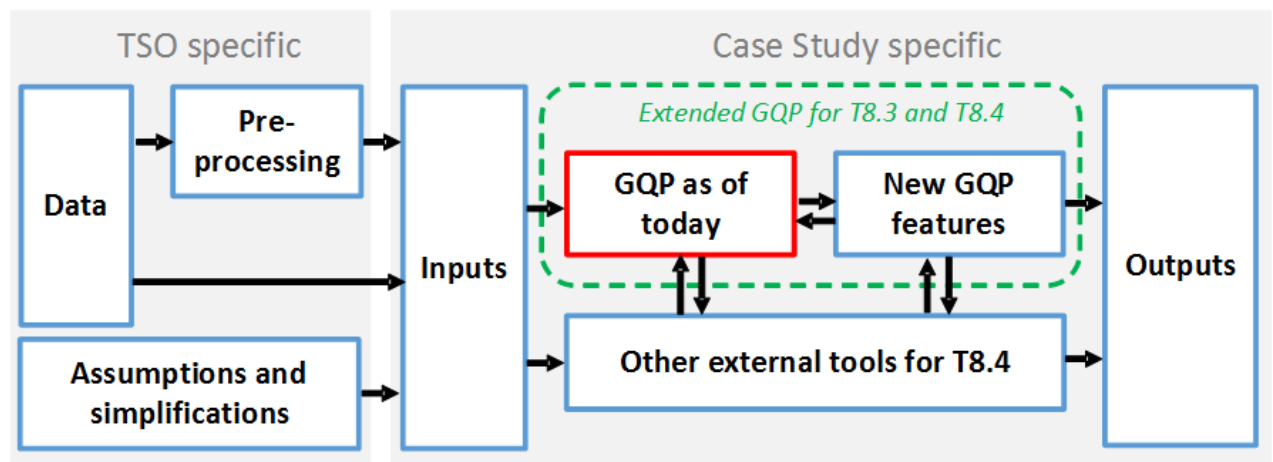


Figure 2: General workflow for the pilot tests.

3.2 Workflow for pilot test 8.3.1 (RTE)

3.2.1 Introduction

This pilot test aims at understanding the main differences one would observe when switching from an N-1 criterion to a probabilistic criterion as defined in GARPUR. The focus here is set on the arbitration between the day-ahead preventive actions, in particular the costly redispatching, and the future real-time corrective actions. The test will run on one full year in order to encompass all the seasonal aspects. It will focus on the south-east region of France which has been responsible for two third of the RTE internal network congestion costs in 2013, mainly due to two parallel lines forming the so called “Tavel-Realtor Corridor”.

As part of this pilot test, RTE also intends to perform sensitivity analyses to study the relationships between inputs and outputs to capture the most influencing factors, in order to prioritize the future work on the modelling of the input parameters.

In the following workflow, the interactions between RTE and the GQP will be described. Some functions of the GQP that are judged essential for the pilot test will be highlighted. Mainly it will concern the data given by RTE and its uses by the GQP, the sampling process, the optimisation trade-off between preventive and corrective actions and the outputs. The graphical convention in Figure 3 will be used to illustrate the workflows: the red colour will be related to data and the blue one to tasks.

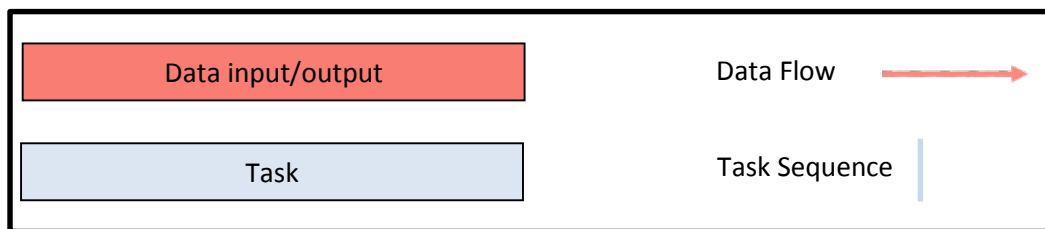


Figure 3: Graphical convention used throughout the description of RTE's pilot test T8.3.1.

To perform the test an important amount of data will be provided by RTE to the GQP. Because all the data necessary to the test are not included in the Day Ahead Congestion Forecast files (DACF files), extra data related to modelling of uncertainties, failure rates, remedial actions, costs and reliability will be also provided.

3.2.2 Reliability data needs and N-1 normalization process

In the following workflow, the data have been separated into subsets: the hourly subset for the data that are time dependent, and the general subset for the data that will remain the same during the whole simulation.

Some data is weather dependent or time dependent. This dependency will be managed outside of the GQP. For example the hourly uncertainty sampling, failure rates, and costs will be externally modified to illustrate this dependency. By doing this, the modelling of uncertainties will be simplified for the GQP, which will allow to easily interact with the platform in order to perform the sensitivity analyses.

Among the hourly data, a “Normalization Data” subset will be provided. The purpose of those data is to decouple the historical time-series embedded in the given DACF files from the decisions taken in day-ahead operation planning to address N-1 congestion forecasts. Very little information is in fact concerned by this normalization process for our test. By modifying only the concerned data, the general pattern of the DACF will stay unchanged, in particular the generation information resulting from the day-ahead market interactions.

Another important input concerns the description of the contingency and remedial action selection zone. For tractability reasons, TSO decisions will focus only on a subpart of the test network. Likewise, only a subset of contingencies and remedial actions should be modelled. The rest of the system will be useful to simulate system responses and for uncertainty modelling. This is illustrated in Figure 4.

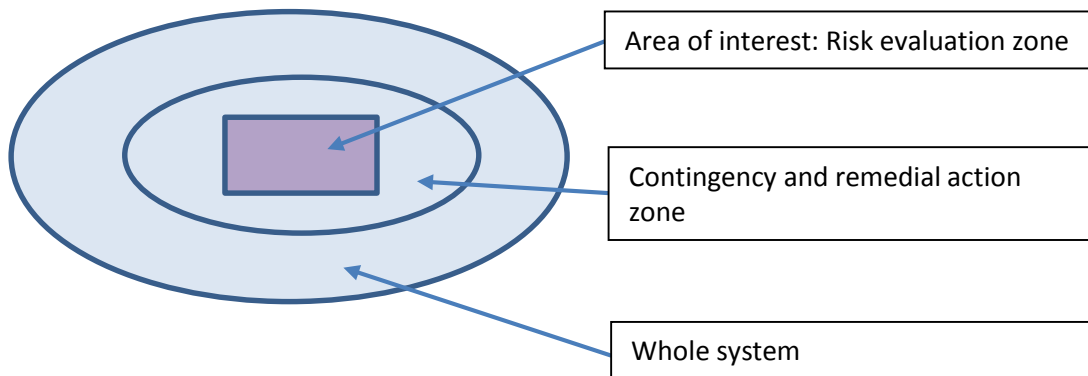


Figure 4: Concepts of risk evaluation zone and contingency and remedial action zone.

3.2.3 General workflow

Figure 5 shows the flowchart of the pilot test. Once the DACF files are normalized, the GQP will have to solve the optimisation problem between the day-ahead and the real-time decisions in order to ensure network reliability at the best socio-economic cost. RTE will provide the GQP with distribution vectors of the errors on load, on renewable energy sources (RES) and on external injections useful for simulating uncertainties on cross-border exchanges. This representation of uncertainties is generic and enables to take into account temporal and spatial correlations between uncertainties.

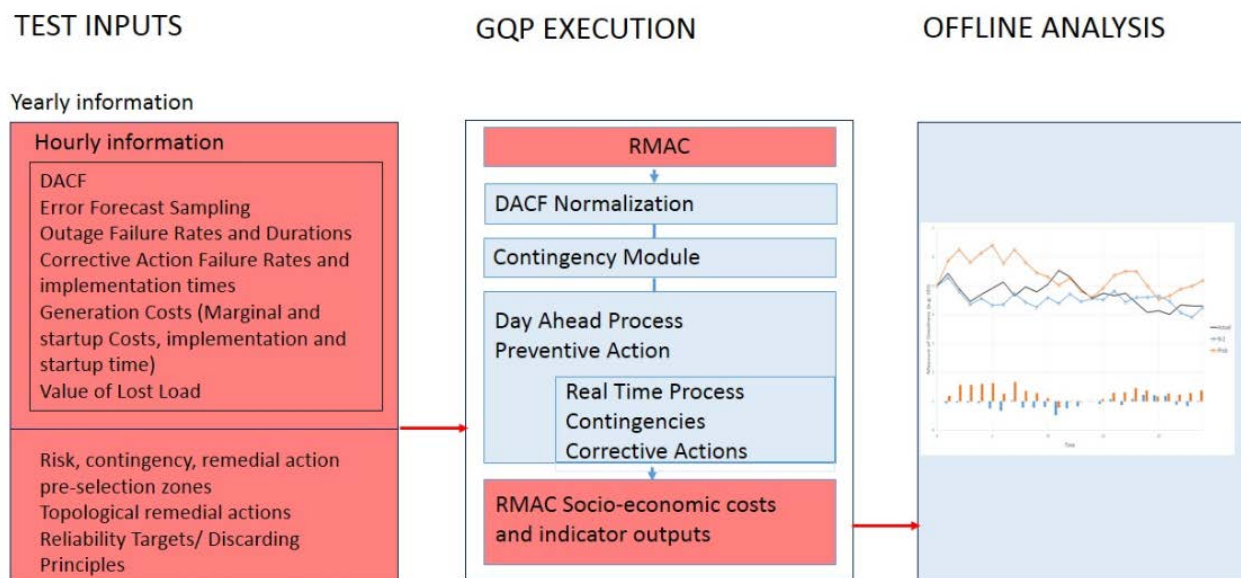


Figure 5: General flowchart of RTE's pilot test 8.3.1.

Figure 6 gives more details about the steps carried out in the day-ahead and real-time processes of Figure 5. In Figure 6 and all other figures, stacked boxes indicate that the same steps are performed on different realizations of the exogenous uncertainty (such as load and RES production) or after the occurrences of different contingencies.

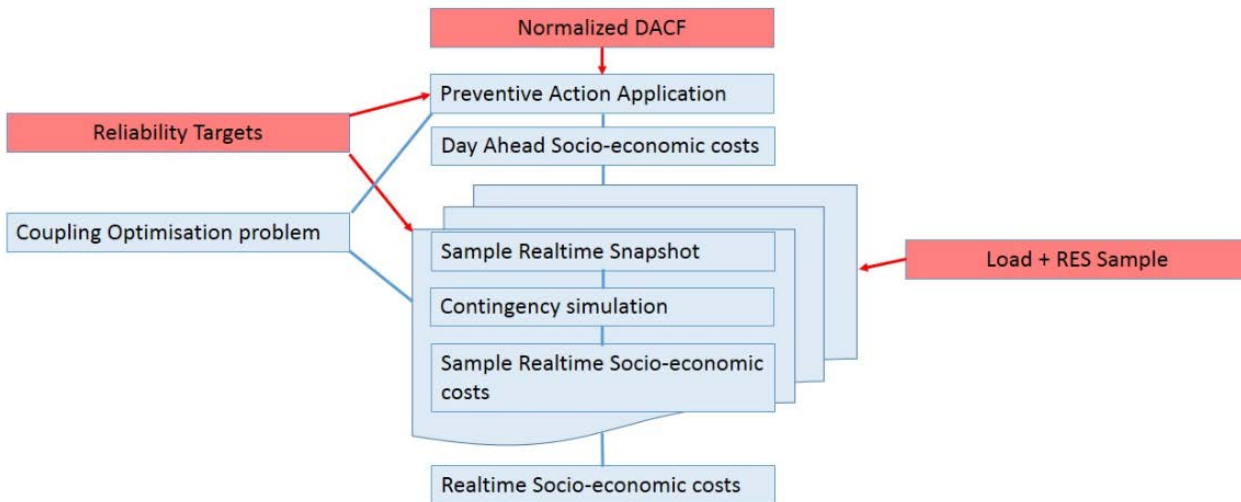


Figure 6: Details on the day-ahead and real-time processes.

The real-time snapshots in Figure 6 are created as illustrated in Figure 7. Following the application of the uncertainties a distributed load balancing function is requested from the GQP. The same function will be requested for normalization, and after contingency and remedial action simulations. This function could be market oriented or not but should preserve the general pattern of the production plan.

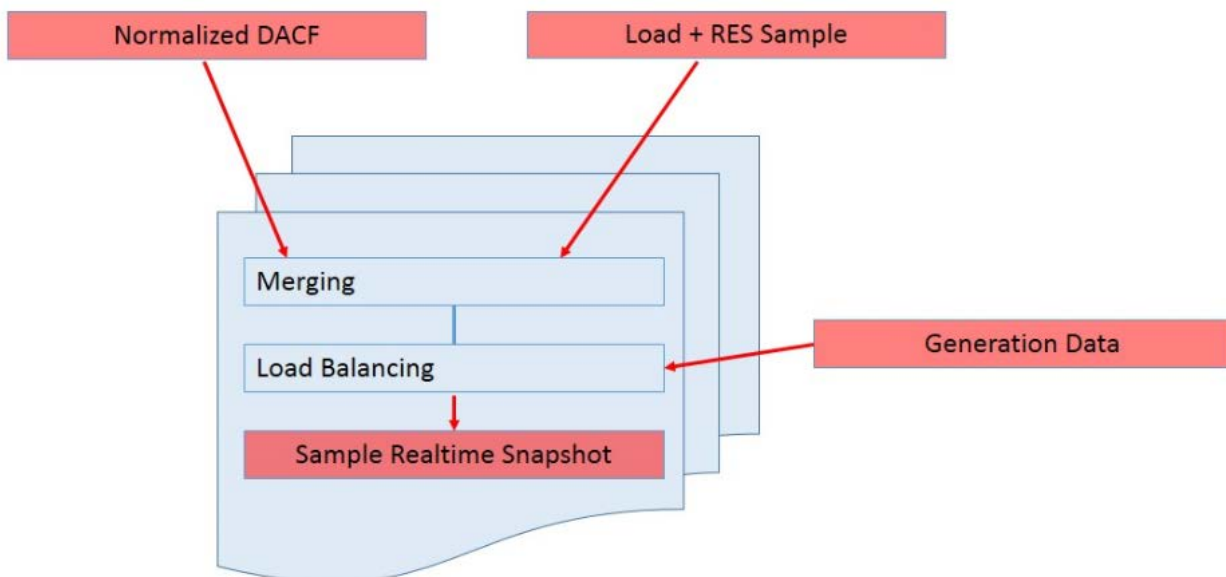


Figure 7: Creation of the real-time snapshots.

The “contingency simulation” block in Figure 6 will work as illustrated in Figure 8.

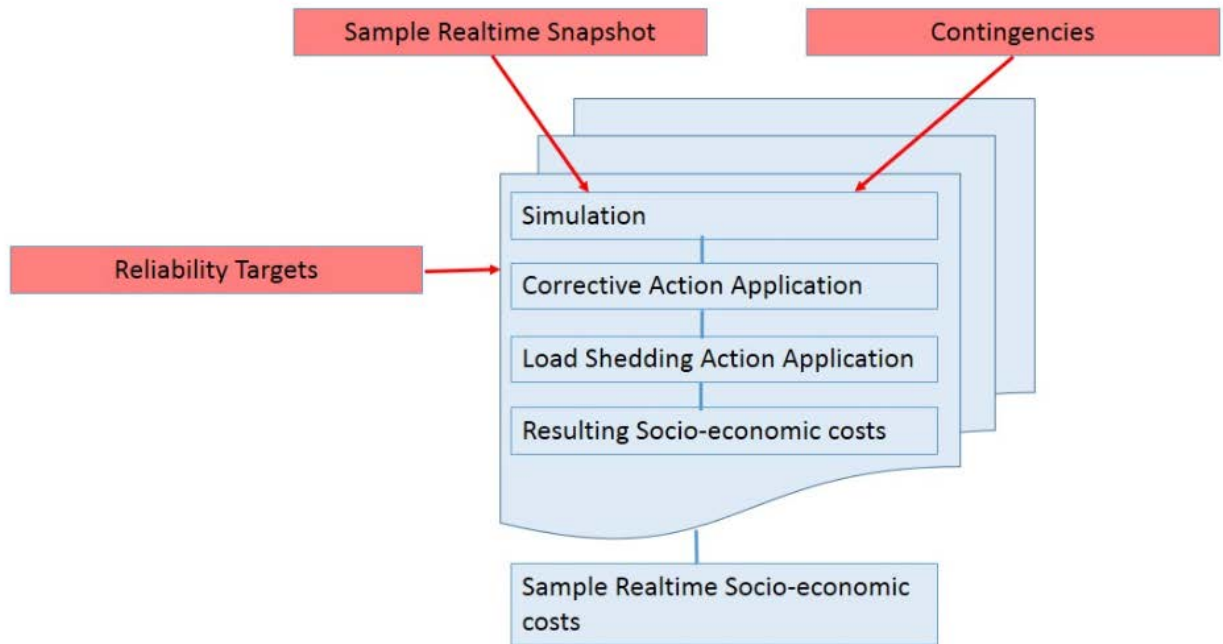


Figure 8: Contingency simulation.

Finally, the preventive actions in Figure 5 and Figure 6 and the corrective actions in Figure 5 and Figure 8 will be simulated as illustrated in Figure 9.

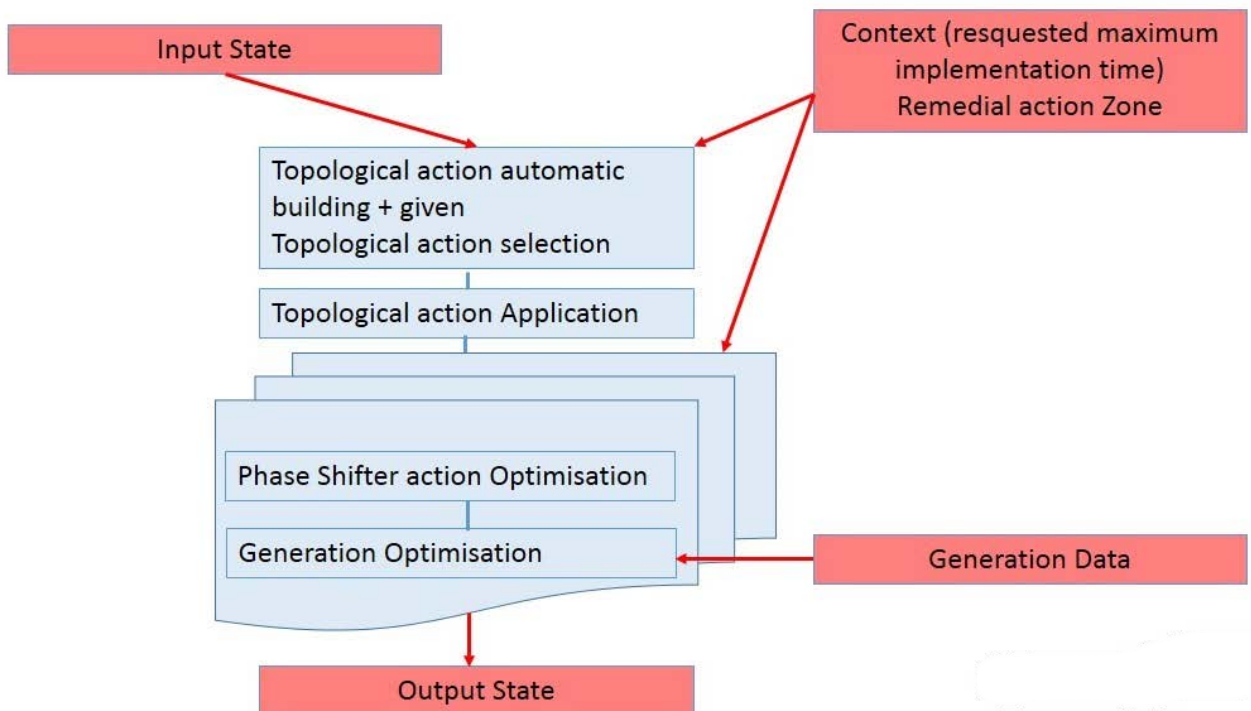


Figure 9: Preventive and corrective actions.

3.2.4 Output for analysis

One of the most interesting functionalities of the GQP will be the multi-level optimisation coupling decision making between preventive and corrective actions. The choice of implementing or not a preventive action will depend on different elements, such as:

- Probability, depth (consequences) and acceptability of the foreseen risk,
- Cost and effectiveness of the preventive action,
- Availability, effectiveness, cost and reliability of corrective actions.

The notion of acceptability is fundamental for the implementation of a new RMAC by TSOs. The definition of the acceptability constraints to be met by the GQP can vary over time, depend on the nature of the risk and on the TSO particularities. Those acceptability constraints can be very complex, and result for example from off-line computations dealing with network stability. Figure 10 illustrates these concepts.

For this particular test special thresholds on lost load in MW and MWh for N-k simulations and specific limits to be respected on some equipment for all the network states have been defined.

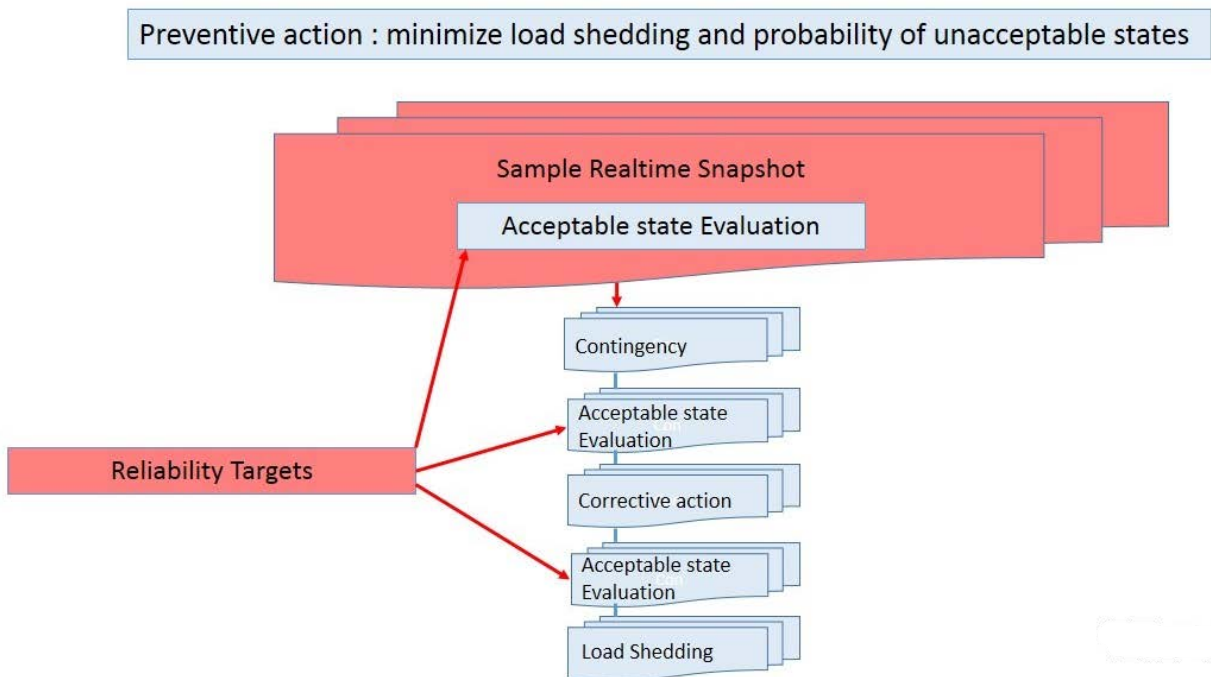


Figure 10: Multilevel optimisation problem, coupling between preventive and corrective actions and concept of acceptable states.

Finally, the relevance of the outputs of the GQP will be paramount. The RTE test is a large-scale test, performed on a whole year of simulations. We will focus principally on the statistical behaviour of global indicators such as:

- Socio-economic costs,
- Global quantification of the risk and efficiency of remedial actions (in MW and MWh for example).

For this reason the GQP is expected to quantify separately:

- The expected costs and energy not supplied as seen from the day-ahead perspective,
- Indicators of the benefits (costs, MWh) brought by the taken preventive actions.
- Similarly, indicators of benefits (costs, MWh) brought by the corrective actions.

3.3 Workflow for pilot test 8.4.1 (Landsnet)

This pilot test relates to real-time risk assessment on the Icelandic transmission system, as outlined in Section 2.3.2. The following sections describe the objectives and data requirements of the pilot test, and discuss the general modelling approach and the expected outputs. For reference, Figure 11 provides an overview of the modelling approach, which is elaborated on in the following subsections.

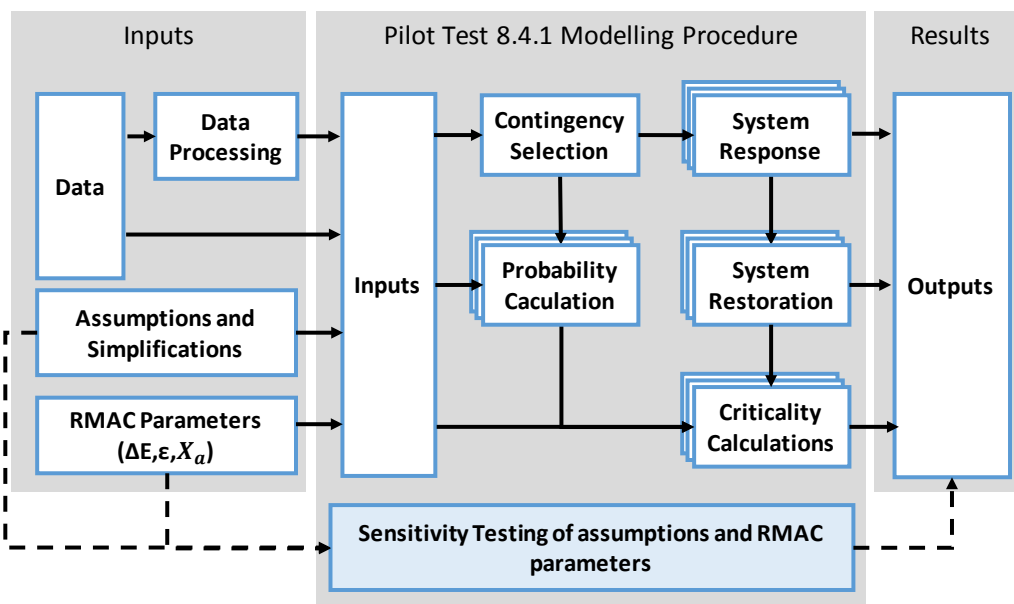


Figure 11: Workflow diagram of the RT near real-life pilot test at Landsnet. The models shown as stacks identify those which must be run for each credible contingency.

3.3.1 Objectives

The objectives of the pilot test are listed below, in order of decreasing priority:

- i) Implement a RT risk assessment model using data available today at Landsnet
- ii) Test the impact of different modelling options on the speed of RT risk assessment
- iii) Investigate methods of displaying the output of the risk assessment
- iv) Test the sensitivity of the risk assessment model to the RMAC parameters (including N-1)
- v) Test the sensitivity of the risk assessment model to failure rates
- vi) Test the sensitivity of the risk assessment model to system protection and control action failure probabilities
- vii) Test the sensitivity of the risk assessment model to changes in WACS logic
- viii) Test the impact of including continuous uncertainty on the speed of the RT risk assessment
- ix) Extend the model to include optimisation of preventive control actions
- x) Test the impact of this extension on model speed
- xi) Assess the practicality of the suggested control actions to suggest shortcomings of the implementation and future improvements

3.3.2 Data collection

The data that will be available as input to the pilot test are:

- Static file describing the system parameters and topology
- Load and generation data exports from the EMS system (5 minute resolution)

- List of available preventive actions
- List of anticipated corrective actions
- Static file describing the system protection and wide-area control schemes
- Component specific fault statistics
- Value of lost load curves [Efla, 2015]
- TSO cost data
- 10 years of simulated historical weather data

3.3.3 Data processing

The data processing required consists of combining the static and variable system data into a single system model file that can be used within MATPOWER [Zimmerman et al., 2009], [Zimmerman et al., 2011]. Processing will also be required to generate time step specific lists of viable preventive and corrective actions (for the control problem, if time and resources allow) as well as formatting system protection and wide-area control schemes rules such that they can be input to a system response. Failure rate models will also be used to convert the fault statistics into failure rates, which can then be used to calculate failure probabilities.

3.3.4 Assumptions

Given the lack of data and tools, the following assumptions must be made:

- Generator costs and emission data
- Consumer distribution at each node
- System protection and control action failure probabilities
- No continuous uncertainty (e.g. loads, weather, economic parameters)
- Presence of secondary/curtailable load on the system
- RMAC parameters will be assumed and their impact on the risk assessment will be a subject of sensitivity testing
- Any outage resulting from a disturbance will last for at least the time period being assessed
- Assume that FACTS devices are fixed or don't exist, due to a lack of real-time data

3.3.5 Modelling procedure

The previous three sections relate to the TSO-specific assumptions and data required to perform a probabilistic risk assessment in real time. Given the above data, the modelling procedure is planned to be as follows:

- 1) Generation of a set of credible contingencies
- 2) Calculation of the probability of each contingency from the failure rates
- 3) For each credible contingency:
 - a) Generation of a set of possible system response trajectories (given failures of control and/or system protection) using a cascading failure model
 - b) For each possible trajectory:
 - i) Estimation of the restoration of the initial system state to determine the quantity of energy not supplied
 - ii) Calculation of the socio-economic surplus of each trajectory, and checking of its compliance with the acceptability constraints
 - iii) Calculation of the probability of each possible trajectory
 - c) Aggregation of the results of 3.b.i and 3.b.ii into expected values for the specific contingency

4) Aggregation of the results of 3.c into expected values for the system state

3.3.6 Probabilistic assessments

The uncertainty in this model comes from two sources, the possibility of contingencies and the uncertainty of system response (system protection or corrective control failure). The set of possible contingencies is reduced to a set of credible contingencies, using a contingency discarding process. This process estimates the residual risk associated with the discarded contingencies, ensuring that the residual risk is below some predefined threshold. The risk associated with the credible contingencies will be estimated by enumeration, as defined by step 3 in the modelling procedure above.

3.3.7 Optimisation problem

The reliability assessment is not an optimisation problem, but particular models used within the system response part of the reliability assessment use optimisation models (AC-OPFs) to simulate the automatic response of the system to each disturbance. This model will aim to simulate the redispatch of generation to mimic the generators operating under droop control. Other control actions are not considered as variables in the system response model, given the assumption that only the planned corrective control actions are taken. That is, the pilot test does not attempt to model the actions of the operator.

An extension to the optimisation of preventive and corrective control, including the setting of system protection schemes, may be pursued if time and human resources are available. The approach has not been formulated yet, but it is anticipated that the optimisation would follow a similar iterative approach, as described by [Karangelos et al., 2016].

3.3.8 Outputs

The specific outputs are not yet defined, and will be the topic of investigation in the third pilot testing objective. The general, system-wide outputs however will be:

- The probability of satisfying the acceptability constraints
- The expected socio-economic surplus
- The residual risk of the discarded contingencies
- Calculation duration

The sensitivity testing will assess the impact of changing the various inputs on these four system-wide parameters.

3.4 Workflow for pilot test 8.4.3 (Elia)

This pilot test corresponds to Elia's long-term test. The introduction to this test is outlined in Section 2.3.4. This pilot test aims at selecting the most representative operating scenarios to be foreseen and to identify the weakness of the power system to meet demand whilst maintaining an adequate level of reliability as dictated by the reliability criterion. Therefore, it does not aim at identifying the best grid reinforcement but to serve as an input for the planner to design candidate grid reinforcement.

In order to do this, the operability of future power system for a given set of credible operating conditions will be studied. A large set of credible operating conditions is considered that models the relevant uncertainties in future operation of the system. This set of credible operating conditions will then be reduced to a subset of the most representative ones to be handled by a planner. This screening is obtained via means of techniques proposed in the WP4.

Figure 12 gives the step-by-step approach of Elia’s pilot test in a form of a flow chart. The current method used for system development in Elia for this screening is a *multi-state approach* that is based on the best estimates of forecasted values. We would like to compare this approach with the approach proposed by WP4 of the project.

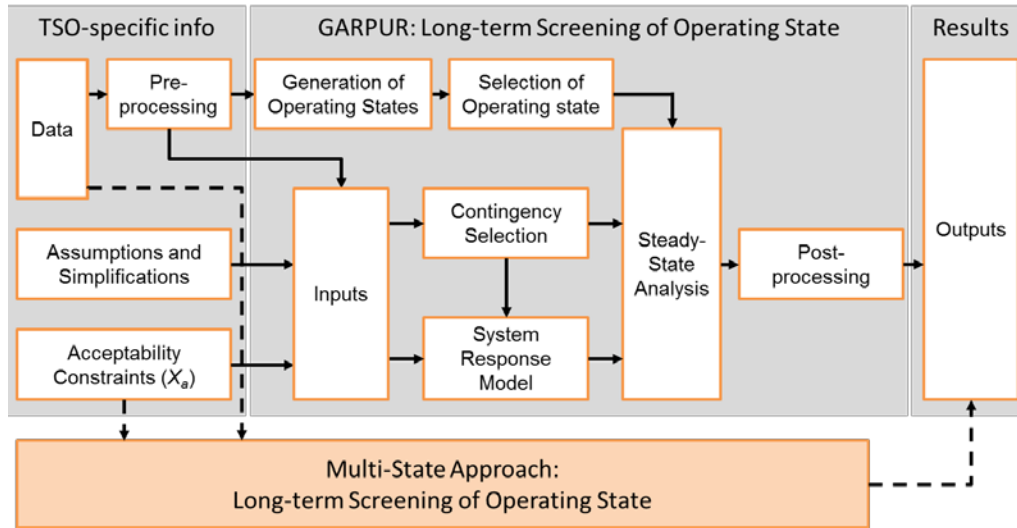


Figure 12: Pilot test to compare the GARPUR methodology and Current Elia’s Multi-state Approach.

3.4.1 TSO-specific information

In the following, we give details about the leftmost box in Figure 12: TSO-specific information.

3.4.1.1 Data

Three types of data are necessary to enable a TSO to plan for system development investments: market modelling data, reliability data and historical data. These three types of data are dependent on the time horizon considered. For this pilot test we use 2030 as a reference year. Moreover the grid model is required to check system response on the given data.

The grid data contains information about the current grid and information and assumptions for future grids. For the test case, the grid data will contain the full Belgium network and the 5 external networks (France, Germany, Netherlands, Luxembourg and Switzerland) from ENTSO-E data (with base voltage ≥ 150 kV). The grid model will be modelled in DlgSILENT PowerFactory. In addition to the grid data, detailed information is needed about the loads and generators that are connected to the grid as well as information and assumptions for the neighbouring grids. This information is contained in ENTSO-E visions. It is proposed to use the fourth ENTSO-E vision of the future: “slow progression” in [ENSTO-E, 2014].

The market modelling data is required to find the credible dispatches of centralized generation and to assess the market behaviour. The minimal requirements are [GARPUR, 2015a]:

- Relative prices of generating units (ENTSO-E data).
- Rules and data that allow credible situations to be synthesised regarding the availability of power from wind, solar and hydro power (historical ENTSO-E data for external countries).
- Spinning reserve requirements (ENTSO-E requirements).
- The availability, size and location of demand response.

For the reliability data, the only available data are the failure and repair rates (historical data) for the elements of the Belgian grid. Elia has no robust information on the evolution of this data for future years and has little information on the reliability of grid elements of neighbouring networks. If needed for the test, it is proposed to consider that the reliability data of the external grid elements is similar to that of the internal grid element.

The available historical data at Elia are the load measurement (15 minute measurements) for all medium voltage substations (base voltage ≤ 36 kV). Moreover, a large part of distributed generation is measured (15 minute measurements). These data are under csv format.

3.4.1.2 Pre-processing

The two steps for pre-processing are as follows:

- The first step is to ensure that all the data is in a coherent form to be used by the analysis part. For example:
 - Creation of the failure rate and repair rate by type of equipment based on past observations,
 - Extraction of load profiles, wind and solar production profiles over the last years.It is expected that functionalities from the GQP in pseudo-code or implemented in MATLAB or Python could be supporting this step.
- The second step is to provide the information necessary to generate credible operating states. Since the method for the generation of operating states is sequential (1 year in one-hour time steps) and it is based on market simulations, it is necessary to provide time series for the renewable energy source (RES) generation and the load. Thus, on the basis of the analysis of historical data, the pre-processing must provide Monte-Carlo (MC) years for a target year (e.g. 2030) for the RES and the gross demand on countries of the study area. The MC years are generated using the MC methods (as they are used in another FP7 project eHighways2050) and are used to model the underlying uncertainties in demand and generation for the target year.

3.4.1.3 Assumptions, Simplifications and Acceptability Constraints

We use the clustering process that is proposed in the task T4.2 of WP4 to build a set of credible future operating states. The following assumptions are made to perform the test in a near-real-life environment:

- The clustering will be limited to Belgian data:
 - For the load, the clustering will be limited to national and regional loads (and a scaling factor will be used to identify the local loads within the regional load),
 - Clustering of wind and PV will be limited to regional level.
- For steady-state contingency analysis after clustering:
 - The analysis will be done using AC-load flow
 - The contingencies will be limited to the Belgian network, or if relevant, to external grid elements of the external influence area.
 - Only the typical preventive and corrective actions for each contingency will be implemented.

First, no operating cost will be estimated. Later, if possible and if time is still available, an OPF will be implemented to identify the most efficient curative action and to compute the related operating cost. When *contingency screening / analysis* is performed on the selected (by clustering) set of operating states which are representative for the future operation of the system, contingency screening is performed to identify the contingencies that pose high risk to the future operation of the system. In this context, both probability and impact are relevant.

The contingency screening process will define the criteria to be used to classify which operating states are secure and which are insecure but also, for each contingency (including eventually the no-contingency state), to record the strength of the constraint violation per element.

Finally, it is also important to specify that the strength of a constraint violation does not only depend on the quantification of the violation but also on the nature of the remedial action needed to bring back the operating state to its secure state. This part, related to the operating cost estimation will only be used if an optimal power flow (OPF) approach is available.

Therefore, as it will be detailed later, two approaches could be used to define an insecure state:

- To see how large the violation is. This leads to the issue of weighting different violations (e.g. overloads or overvoltages) and violated elements (e.g. major 380kV line or local 36kV/MV transformer).
- To study how much it costs to solve the violation problem.

The criteria to be used to identify a violation are as follows:

- The criteria related to voltages are given in Table 2.
- The criterion related to overloads is given in Table 3. From Table 3 we can observe that if a temperature is given for an operating state, then it is possible to deduce the corresponding season as the temperatures defined in the table do not overlap for seasons.
- The criteria related to short-circuit power are given in Table 4.

Table 2: Voltage acceptability constraints.

Voltage level			380	220	150	70	36	30
Material limit			420	245	170	82.5	40.5	36.0
Operating voltage		100%	400	225	155	70	36.0	30.0
High voltage	In all situations	105%	420	236	163	73.5	37.8	31.5
	For N and N-1 situations (except N-1 busbar)	92.5%	370	208	143	64.8	33.3	27.8
Low voltage	For N-1 busbar and N-X situations with X>1	90.0%	360	203	140	63.0	32.4	27.0

Table 3: Overload acceptability constraints.

Seasons	From day	To day	Temperature	Line (of Inom*)	Cables (of Inom*)	Transformers (of Inom*)
Winter	16/11	15/03	0° < T° < 11°	112%	100%	107%
Inter-season	16/03 Or	30/04 Or 15/11	11° < T° < 17°	106%	100%	103%

Seasons	From day	To day	Temperature	Line (of Inom*)	Cables (of Inom*)	Transformers (of Inom*)
	01/10					
Summer	01/05	15/07	17° < T° < 23°	100%	100%	98%
	Or 01/09	Or 30/09				
High Summer	16/07	31/08	T=30°	90%	100%	92%

*Inom = nominal current.

Table 4: Short-circuit power acceptability constraints.

Voltage level	380	220	150	70	36	30
Short-circuit power (MVA)	32.9 41.5*	15.2	10.39 13.0*	2.42 3.82*	1.96	1.64

* represents specific busbars.

Finally, if possible to be computed, a minimum short-circuit power at 380kV, 220kV and 150kV substation where non-renewable generations are connected should be at least twice the nominal power of the machines at that substation (i.e. this is a simplification of the stability criteria $S_{sc_ext}/S_n > 5$ where S_{sc_ext} is the contribution in terms of short-circuit from the grid, and S_n is the nominal power of the machine).

The estimated operating costs for the remedial actions can be assumed as follows:

- Redispatching cost: 80€/MWh
- Renewable generating curtailment: 150€/MWh
- Load shedding: 8 000€/MWh

For sake of simplicity, the estimated duration of a remedial action is associated to the duration of the clustered operating state.

Finally, some remedial actions should be applied preventively in order to avoid situations of high risk (i.e. where risk is above some given threshold.). Other remedial actions should be applied curatively (i.e. with a probability which is the probability of realization of the contingency in this operating state). A simple proxy for applying preventive actions could be as follows:

- High voltages are above material limits.
- Low voltage are below 90.0% of Operating voltage (see criteria above for N-1 busbar and N-X situations with $X > 1$).
- Line, cable or transformer with overloads 30% above the nominal current.
- Short-circuit power is above acceptance criteria (see above).
- Short-circuit power is below acceptance criteria (see above).
- The EENS per operating state is, for example, above 3MWh (only valid if costly remedial actions are defined).

3.4.2 Long term screening of operating state

3.4.2.1 Generation of operating states

An operating state is a particular realisation of the network configuration, generation and demand levels, as well as flows between interconnected control areas. A market model tool written in Python and previously developed at Strathclyde University will be used to generate time series of operating states (e.g. hourly operating states). This model is a unit commitment model with economic dispatch. The input for this tool is demand, generation capacities and cost functions of various generation types. The output will be a time series of generation commitments and operating states.

3.4.2.2 Selection of operating state

This selection step is intended to provide operating states for steady-state analysis. Thus, for each of the seasons as defined in Table 4, typical days are clustered.

Work is ongoing in work package 4 to develop a method to carry out this step. Nevertheless, the first approach would be to perform a DC load flow (DC-LF) based on time series provided by the box "generation of operating states". Then, clustering is performed based on the results of the DC-LF. Possible criteria for clustering could be:

- Physical flows on different border lines,
- Net balance of the country.

3.4.2.3 Contingency selection (or contingency generation)

In line with the ideas defined in Task 4.2, the security of every clustered operating state (except N-1-1, see below) will be checked for:

- The N-0 situation
- The N-1 situations representing unplanned contingencies and for which the typical topological curative actions are stored in a database and applied.
- The N-1 situations representing planned outages. Typical topological preventive actions for each planned outage are stored in a database and applied.
- The N-1-1 situations with the 2 elements located in the same electrical area. This situation represents a planned outage and an unplanned contingency. Typical topological preventive actions for each planned outage are stored in a database and applied. For unplanned contingencies, the typical topological curative actions are stored in a database and applied.

It is important to note that, as a proxy of the maintenance planning stage, we consider that it is not needed to plan high voltage grid element outages during high load situation (winter periods) and during summer periods with low line ratings and low crew availability due to the matching with the holiday period. Therefore, we propose to sample the N-1 planned outages situation and N-1-1 situations for the inter-season period only.

3.4.2.4 System Response Model

The system response model will be AC load flow computations checked at 3 time instants:

- Pre-incident steady-state behaviour (i.e. N and N-1 planned outages). Ideally an OPF should be computed. If this functionality is not available, local voltage droop controller will be implemented for every transformer and for voltage control of every generator having MVar contracts.
- Intermediate behaviour ($500\text{ms} < t < 15\text{min}$) after unplanned contingency (i.e. N, N-1 unplanned contingency and N-1-1). Ideally, only automatic tap changing transformers and voltage droop

control on generators above 25MW will be active. No curative control will be applied. The conditions for selection between preventive and curative actions (see above) should be checked.

- Post-incident steady-state behaviour (15min<t<30min-1h) (i.e. N, N-1 unplanned contingency and N-1-1). In addition to the system response of the previous time frame, voltage droop control on generator with MVar contracts and on manual tap changer are implemented together with the topological curative actions to represent the system operator actions.

The details of the system behaviour are provided in Table 5.

Table 5: System behaviour.

	Pre-incident steady-state behaviour	Intermediate behaviour (500ms<t<15min)	Post-incident steady-state behaviour (15min<t<30min-1h)
Objective	Optimal voltage regulation incl. optimal share of reactive reserves	Automated reactions, temporary overload of equipment, no manual actions	(non-optimal, pre-scribed) manual actions, steady state equipment ratings
Most Elia transformer	Optimal tap	No tap change	Manual LDC like control
Elia transformer towards 36kV pockets	Optimal tap	LDC control	LDC control
Distribution transformers	V control @ MV busbar	V control @ MV busbar	V control @ MV busbar
Units P<25MW	Q=0 @ Scc*	Q=0 @ Scc*	Q=0 @ Scc*
Units P>25MW, no MVar contracts	Q=0 @ HV busbar	Voltage droop@ HV busbar	Q=0 @ HV busbar
Units P>25MW with MVar contracts	Optimal V control @ HV busbar	Voltage droop@ HV busbar	Voltage droop@ HV busbar
Shunts	Optimal usage of shunts		Enable shunts tap control

*Scc: Short-circuit power

In addition to the above, if a curative control optimal power flow (OPF) is available, this OPF is applied to the post-incident steady-state behaviour in order to represent the costly remedial actions (redispatching, renewable generation curtailment and load shedding). For sake of simplicity, this steady-state incident is considered to last for one hour. In addition, again for sake of simplicity, no cascading event due to overloads, undervoltage, undervoltage or dynamic event is represented.

3.4.2.5 Steady-state analysis

In a power system, single element outage (N-1) often leads to small changes and also to limited transients. Therefore, the post-incident operation of the power system can be modelled by an algebraic model i.e. not a time varying model. In this subsection we define a methodology to perform a steady state security analysis of a power system.

As mentioned in the previous section, a system response can be determined by solving an AC load flow calculation. In order to solve an AC load flow problem, one needs initial conditions. Such initial conditions

can be obtained by a market model, single slack bus or distributed slack bus as well as voltage control scheme (e.g. OPF for optimal reactive power management or local controllers at generator terminals). The objectives that we want to achieve through the steady-state security analysis are as follows:

- Rank the credible operating conditions according to criticality: most critical post-incident operating conditions require attention of a system planner;
- Answering the question: “how critical is the critical condition?” We note that an overload of a line can be tolerable if it is not too big and does not happen for too long. Similarly some voltage violations are more tolerable (or can be quickly mitigated) than others.

To achieve the above objectives, we propose two methods to implement in the pilot test.

The first method, termed steady-state security analysis, is rather straight forward and depends on the magnitude of the overload (steady-state security analysis). Load flows are solved for all the credible operating conditions and the constraint violations are recorded. A threshold depending on the exogenous variables is set (e.g. in winter line ratings are 110%). Any violations exceeding the threshold are collected in a set and are ranked based on the value of the constraint violation. In order to compute these violations, automated reactions of the loads, generators and tap changer need to be implemented in the security analysis as defined in “System Response Model”.

The second method, called secure market dispatch, is slightly more involved and ranks the critical operating conditions based on the cost of corrective actions, which would be implemented if the time and resources permit. An optimization model that is centred at the post-contingency operating state is constructed to identify the most efficient curative actions. Strict constraints are imposed on the bounds and the optimization problem is solved to re-secure the operating state. The solution of this optimization problem will provide us with the cost of the corrective action. Based on the cost of corrective action, the critical operating conditions are ranked noting that the most critical operating conditions are those that are most expensive to correct.

3.4.2.6 Post-processing

After the computation defined in the phases “Steady-state analysis”, data will be aggregated taking into account the probability of occurrence of each situation in order to screen the operating state and the contingencies that are the most contributing to the risk of the operation of a power system such as the one proposed.

3.4.3 Results

In the context of this near-real life test case, the “GARPUR approach” will be the simplified representation of the work of WP4 on long-term screening of operating states, which is to be implemented as described above. In order to validate the approach, the following indicators will be needed:

- Screening indicators will provide the planner with information about needed grid reinforcements and situations in which these grid reinforcements are needed. These indicators are described in Section 0
- Assessment indicators will enable the comparison of the proposed “GARPUR approach” with the so-called “multi-state approach” currently in used within Elia. These indicators are very similar to the ones provided by the “multi-state approach”. These indicators is described in Section 3.4.3.2

3.4.3.1 *Outputs of GARPUR approach*

The outputs of the GARPUR approach will be:

- Supporting information for the planner:
 - Priority list of weaknesses of the power system. This priority list takes into account the probability of occurrence of each N, N-1 or N-1-1 situations as well as its impact to define risks (probability*impact).
 - If the “steady-state security analysis” is implemented, the impact will be defined by the magnitude of the violation weighted by a severity factor function of the violation type and by the element type.
 - If the “secured market dispatch” is implemented, the impact will be defined by the operating expenditures (OPEX) needed to solve the constraint.
 - Annual average, maximum and minimum total system risk.
- For each screened operating state, for each screened planned and unplanned outages situation, for each element and for each operating constraints, the following information will be provided:
 - A histogram of the constraint violations.
 - The probability of the constraint violations.
 - The average, minimum and maximum values of the constraint violations.
 - Evaluation of the quality of the clustering of operating states: some indicators will be provided on the quality of the clustering. These indicators still need to be defined in the further work.

3.4.3.2 *Outputs of GARPUR approach for the comparison with the multi-state approach*

On basis of data provided by the GARPUR approach and the Multi-state approach, the pilot test study aims to make a comparison. First, the comparison will be quantitative in terms of:

- Total computing time,
- Number of screened operating states to be further studied by the planner.

Second, a manual evaluation of the differences between the two approaches will be performed by planners. Relevance of lost/added operating states, of lost/added maintenance and screened outages will be among the conclusions to be expected of the comparison.

4 METHODOLOGY FOR THE ASSESSMENTS OF PILOT TESTS

In this section, indicators that can be used to either assess or compare different reliability criteria are given. In Section 4.1, the indicators proposed by the work in work packages 2 and 3 are reviewed. In Section 4.2, the indicators outlined in the specifications of the pilot tests are summarized. In Section 4.3, the indicators which are currently available in the GARPUR quantification platform (GQP) for the pilot tests in task T8.3 are listed.

4.1 Assessment as proposed by the theoretic work of GARPUR

4.1.1 Socio-economic impact assessment

This section summarizes the socio-economic impact assessment as proposed by work package 3 (WP3), focusing on a qualitative description of the assessment method rather than looking at the details, for which the reader is referred to [GARPUR, 2016]. The socio-economic impact assessment under development in WP3 aims at studying the difference of surplus between different reliability-related TSO decisions in multiple decision-making contexts, both aggregated and for different stakeholder groups separately. The socio-economic impact assessment is carried out for a system defined by:

- The assessed market, i.e. the electricity market.
- The included stakeholder groups, i.e. electricity consumers, electricity producers, the TSO, the government surplus from taxes on electricity and environmental surplus from electricity related externalities.
- The geographical scope, i.e. the TSO area and neighbouring areas affected by the TSO decisions to the extent that the impact is significant. This geographical scope also needs to be defined in the pilot test.

Surplus is defined as the difference between the benefits and the costs to a stakeholder or the system under study. As the difference in surplus will be studied, only costs and benefits that significantly change between different decisions need to be included.

The overall socio-economic indicator proposed by WP3 is aggregate surplus in the system. It is defined as the difference of consumer benefit and all costs and can be formulated in simplified form as:

$$S = Dv - [c_{INT} + c_{TSO} + C_{TSO} + C_{gen} + (D - u)(c_{gen} + c_{ENV}) + c_{cong}] \text{ [€/h]},$$

where the symbols are defined below:

D	price-inelastic demand [MW]
v	value of served load [€/MWh]
u	unserved load [MW]
c_{INT}	interruption cost [€/h]
c_{gen}	variable generation costs [€/MWh]
C_{gen}	generation investment costs [€/h]
c_{TSO}	variable TSO costs [€/h]
C_{TSO}	fixed TSO costs [€/h]
c_{ENV}	environmental cost [€/MWh]
c_{cong}	congestion cost [€/h]

Aggregate surplus is independent of prices, and any payments, tariffs or taxes, due to the assumption of no market response¹ and assuming that surplus to all market participants is valued equally. More detail can be found in [GARPUR, 2016].

In addition to aggregate surplus, the framework developed in WP3 allows to compute the surplus of different stakeholders or groups of stakeholders.

4.1.2 RMACs as defined in WP2

Work package 2 has proposed formulations for reliability management approaches and criteria (RMACs) for long-term planning, mid-term asset management, short-term operation planning and real-time operations. The proposed probabilistic RMAC seeks to ensure that the system follows an acceptable trajectory with a large probability for a subset of all possible scenarios for the considered uncertain exogenous parameters, while ensuring that the residual risk of the discarded scenarios is below a pre-defined threshold. The efficacy of different decisions are compared by using expected aggregate surplus as defined in the previous section. The proposed ingredients of an RMAC are therefore:

1. The aggregate surplus.
2. A discarding principle that sets a threshold on the residual risk of discarded scenarios.
3. A reliability target which ensures that the system fulfils acceptability constraints with a high probability.

Three indicators are therefore involved in the RMAC:

1. The probability of violation of the acceptability constraints.
2. The residual risk of the discarded scenarios.
3. The expected aggregate surplus.

4.1.3 N-1 criterion

The N-1 criterion is defined in [GARPUR, 2014a] as follows:

“The N-1 criterion is a principle according to which the system should be able to withstand at all times a credible contingency – i.e., unexpected failure or outage of a system component (such as a line, transformer, or generator) – in such a way that the system is capable of accommodating the new operational situation without violating operational security limits.”

Therefore, given a list of contingencies, indicators related to the N-1 criterion are whether or not the operational security limits are satisfied in the pre- and post-contingency system states.

4.1.4 Summary

Five types of indicator have been identified above:

1. Aggregate surplus.
2. Surplus of different stakeholders.
3. Probability of violations of acceptability constraints.
4. Residual risk of discarded scenarios.
5. Operational security limits satisfied in pre- and post-contingency system states.

¹ Demand is inelastic (ST & LT price elasticity of demand is zero) and no demand shifting to other times in case of interruptions (elasticity of intertemporal substitution is zero)

Indicators 3 to 5 are all related to the definitions of the reliability criterion while indicators 1 and 2 are used to compare different reliability criteria. All indicators can be computed for any reliability criterion. However, a system operated according to an RMAC such as defined in Section 4.1.2 will be optimized for indicators 1, 3 and 4 whereas a system operated according to the N-1 criterion will be optimized for indicator 5.

These different indicators all capture different aspects of the reliability criterion that is used. Indicators 1, 2 and 4 are socio-economic indicators. In contrast, indicators 3 and 5 measure the security of the system.

4.2 Assessment as proposed by the pilot tests

This section summarizes how the different transmission system operators (TSOs) want to assess their specific pilot test given the metrics obtained from simulating the different RMACs. Most of the indicators are related to the indicators as described in the theoretic part of GARPUR and summarized in Section 4.1.4.

Common for all the socio-economic indicators is that the indicators should be able to break down to different aggregation levels, both in time, topology or other information levels. To give an example, such a hierarchical aggregation order for real-time operations could follow the order of first obtaining an expected socioeconomic cost over all contingencies, second breaking down the expected socioeconomic cost by the contingencies' cost contributions and third by the type of action, either preventive or corrective.

In detail, the following socio-economic indicators are mentioned by the TSOs for the pilot studies, as discussed in Chapter 3. They cover different aggregation levels and the list presented here is not exhaustive:

- Annual average, max and minimum total system risk.
- Cost for performing the preventive or corrective actions.
- Efficiency of remedial actions quantified separately for preventive and corrective action.
- Socioeconomic cost associated with uncertainties and contingencies.
- Risk reduction as taken into account by preventive or corrective actions with associated costs and changes in socioeconomic costs.
- Interruption costs.
- Aggregate surplus.

Another group of indicators is related to the operational security, including:

- Residual risk
- Number of critical operating states
- Probability distributions of violation of operating constraints, including average, minimum and maximum values. Violations could be measured units as MW, MWh or duration of overload.

In addition to the socio-economic and operational security indicators, TSOs are also interested in more detailed information regarding priority lists of actions suggested by the models. Proposed indicators are:

- List comparing preventive and corrective actions that have been chosen by the model when running with different reliability criteria.
- List of actions given by the models that could be used to avoid stressed situations in the system upfront is also of interest.
- Priority list for the weaknesses of the power system that takes into account both the probability and impact of all N-x contingencies.

Another indicator of interest is the computational speed of the whole reliability assessment by measuring the time needed for complete or partial assessments. This can give valuable information on the computational limits for using different reliability criteria.

An additional topic of interest is the sensitivity of the indicators to data and modelling assumptions. Examples of such data uncertainties are:

- Probabilities of contingencies and failure modes.
- Durations, volumes and valuation of service interruptions.

Furthermore, the comparison of the results with historic data for different historic system states is important to get an understanding of the model quality.

Assessments performed by persons that are familiar with the power system in question is another method emphasized by the TSOs. The model output should for example be compared against all important aspects of some historical high risk operating situations to understand if the model has a good quality or is missing some modelling features or data. Also, a manual evaluation of the model outcome should be performed with the goal to understand the logical reasoning behind the differences in the model outcome between two different reliability criteria approaches. For example, for long-term system development, the relevance of lost/added operating states, of lost/added maintenance and screened outages will be among the conclusions to be expected of such a comparison.

4.3 Assessment metrics available in the GQP-prototype

In the analysis performed in the GQP platform, several parameters are calculated and stored for further analysis. Several of these can either be aggregated or combined to match the mentioned assessment metrics proposed in the two previous sections (Sections 4.1 and 4.2). Note that, at the time of writing, even though the data is available, not all functionality for displaying the results are currently implemented.

The data (parameters) available from the evaluation module of the GQP platform are:

- Probability of operating states and of contingency occurrences. Here the probability of “no contingency” is also included.
- Power Not Supplied (PNS) for both states, contingency and location (MW).
- Expected Energy Not Supplied (ENS) for both states, contingency and location (MWh).
- Expected Cost of Energy Not Supplied (CENS) for both state, contingency and location (€).
- Generation post contingency re-dispatch for both state, contingency and location (MW).

In the summary of Section 4.1, five indicators were identified:

1. Aggregate surplus.
2. Surplus of different stakeholders.
3. Probability of violations of acceptability constraints.
4. Residual risk of discarded scenarios.
5. Operational security limits satisfied in pre- and post-contingency system states.

Of these the GQP module currently only calculates an expected reliability cost defined as the sum of a CENS and generation re-dispatch costs, as an approximation for the aggregate surplus. This can also be presented as function of “state” or “time”. The residual risk is in principle an input to the module and could be provided in future versions of the prototype.

In Section 4.2, a list of socio-economic indicators are mentioned by the TSOs for the pilot studies, where some can be provided by the GQP platform depending on the level of details required and provided to the platform. The annual averages, maximum and minimum values of risk can easily be extracted and visualized, where risk is calculated as the probability of the contingency occurring multiplied with the consequence. Currently only generator re-dispatch is available as corrective action, where the values are given in MW and MWh. For these corrective actions the associated cost is also available.

5 CONCLUSIONS

In this report, eight pilot tests have been proposed. These pilot tests aim at assessing and validating, as closely as possible to real-life conditions, the new Reliability Management Approach and Criteria (RMAC) developed in work packages 2 and 3, while considering the methodologies and approaches for practical implementation in work packages 4, 5 and 6. In addition, these pilot tests will compare the proposed reliability criteria to the current N-1 reliability criterion. Five different TSOs are involved in the pilot tests: ČEPS in Czech Republic, Elia in Belgium, ESO in Bulgaria, Landsnet in Iceland and RTE in France. Altogether, the pilot tests cover real-time operations, short-term operation planning and long-term system development.

The eight pilot tests have been ranked according to a priority list. The three pilot tests with priority level 1 will start in 2016. The feasibility of the two pilot tests with priority level 2 will be re-evaluated once enough experience has been gained from the pilot tests with priority 1. The three pilot tests with priority level 3 will be run if resources are still available. Among the pilot tests with priority level 1, one will use the GARPUR quantification platform developed within the GARPUR project whereas the remaining two will be carried out in near real-life context.

The specifications of each pilot test with priority level 1 in terms of processes and output indicators were given. A set of indicators was given to compare different reliability criteria in each pilot test. In addition, each TSO proposed additional indicators that will allow them to assess and compare all reliability criteria according to their internal policies.

6 APPENDIX

In this appendix, the flowcharts defining the different steps for performing the pilot tests with priority level 2 are given. As described in Section 0, the feasibility of performing these pilot tests will be evaluated, based on the experience gained from starting up the tests with priority 1.

6.1 Workflow for pilot test 8.3.3 (ČEPS)

This pilot test will be carried out as illustrated in Figure 13. The following subsections describe each step in more detail.

6.1.1 Preparation of data

The input DATA will be DACF files and snapshots (SNPs in Figure 13). The block “preparation of data” is used to prepare the input data for the GARPUR quantification platform. In the pre-processing phase, the data of the neighbouring power systems is scrambled for confidentiality reasons. After the data has been scrambled, a load flow is computed to establish the base case before running contingency analyses. The DACF files contain data for the whole continental Europe. The data from these files will be reduced to the Central Eastern Europe (CEE) region.

In parallel with the preparation of the input snapshots and DACF files, some extra files must be prepared, which will contain reliability data and some additional data about generators and branches.

In addition, two more files will be used as input data to feed the process of reliability evaluation. The first one will contain RAW data of the CEE network and the second one will provide a list of preventive and corrective actions, which were planned on that day.

6.1.2 GARPUR quantification platform (GQP)

The process of reliability evaluation starts with contingency analysis. Using the proposed RMAC, it is expected that the results of contingency analysis will provide the probabilities of overloads, overvoltages and undervoltages in some parts of the network. Currently, contingency analysis is based on the N-1 criterion and runs approximately every five minutes.

With the list of results from contingency analysis it will be possible to identify the weakest elements in the network in case of outages of some other elements. Some actions (preventive or corrective actions) can be carried out to avoid these outages or to reduce their consequences.

The preventive or corrective actions can be re-dispatching over standard generation units, switching of overhead lines, reconfiguration of substations and re-dispatch via HVDC links. The exact description of what was planned and what was used in the particular day under study in this pilot test will be available. This information can be used to compare the proposed RMAC with the N-1 based operator actions.

After preventive and corrective actions determined in contingency analysis have been implemented, an optimization process will be performed to determine actions in order to, for example, reduce losses or cost of generation. In this process it is important to define a list of components which can be changed in status, i.e. components on which it is possible to perform actions. For example, it is not appropriate to change the active power output of nuclear power stations. The optimization process is an iterative process which can for example be based on a security-constrained optimal power flow. If any of the optimization actions is accepted, it is necessary to repeat the optimization process, because each change in the topology of the electrical network can create a change in load flow as illustrated by the backward loop in Figure 13.

6.1.3 Evaluation of outputs

Expected outputs of GQP are the list of preventive and/or corrective actions which are suggested by the new RMAC or by the N-1 criterion. It is expected that the evaluation process will provide ČEPS with the exact actions to operate their system so as to meet the reliability criterion (proposed RMAC or N-1). These actions can be compared with the ones that were used on that day by the operators.

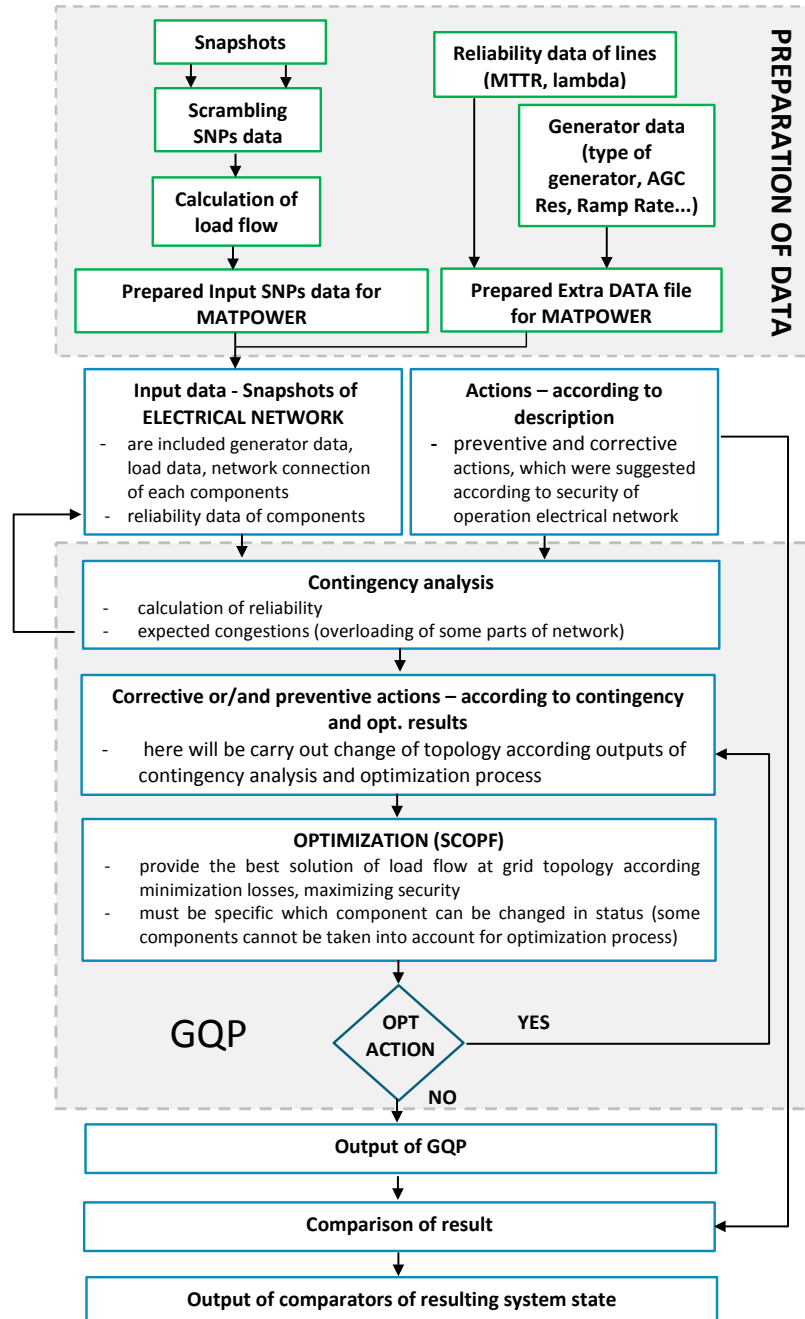


Figure 13: Flowchart of ČEPS' pilot test.

6.2 Workflow for pilot test 8.4.5 (ESO)

Figure 14 shows the flowchart of ESO’s pilot test. The following subsections describe each step in more detail.

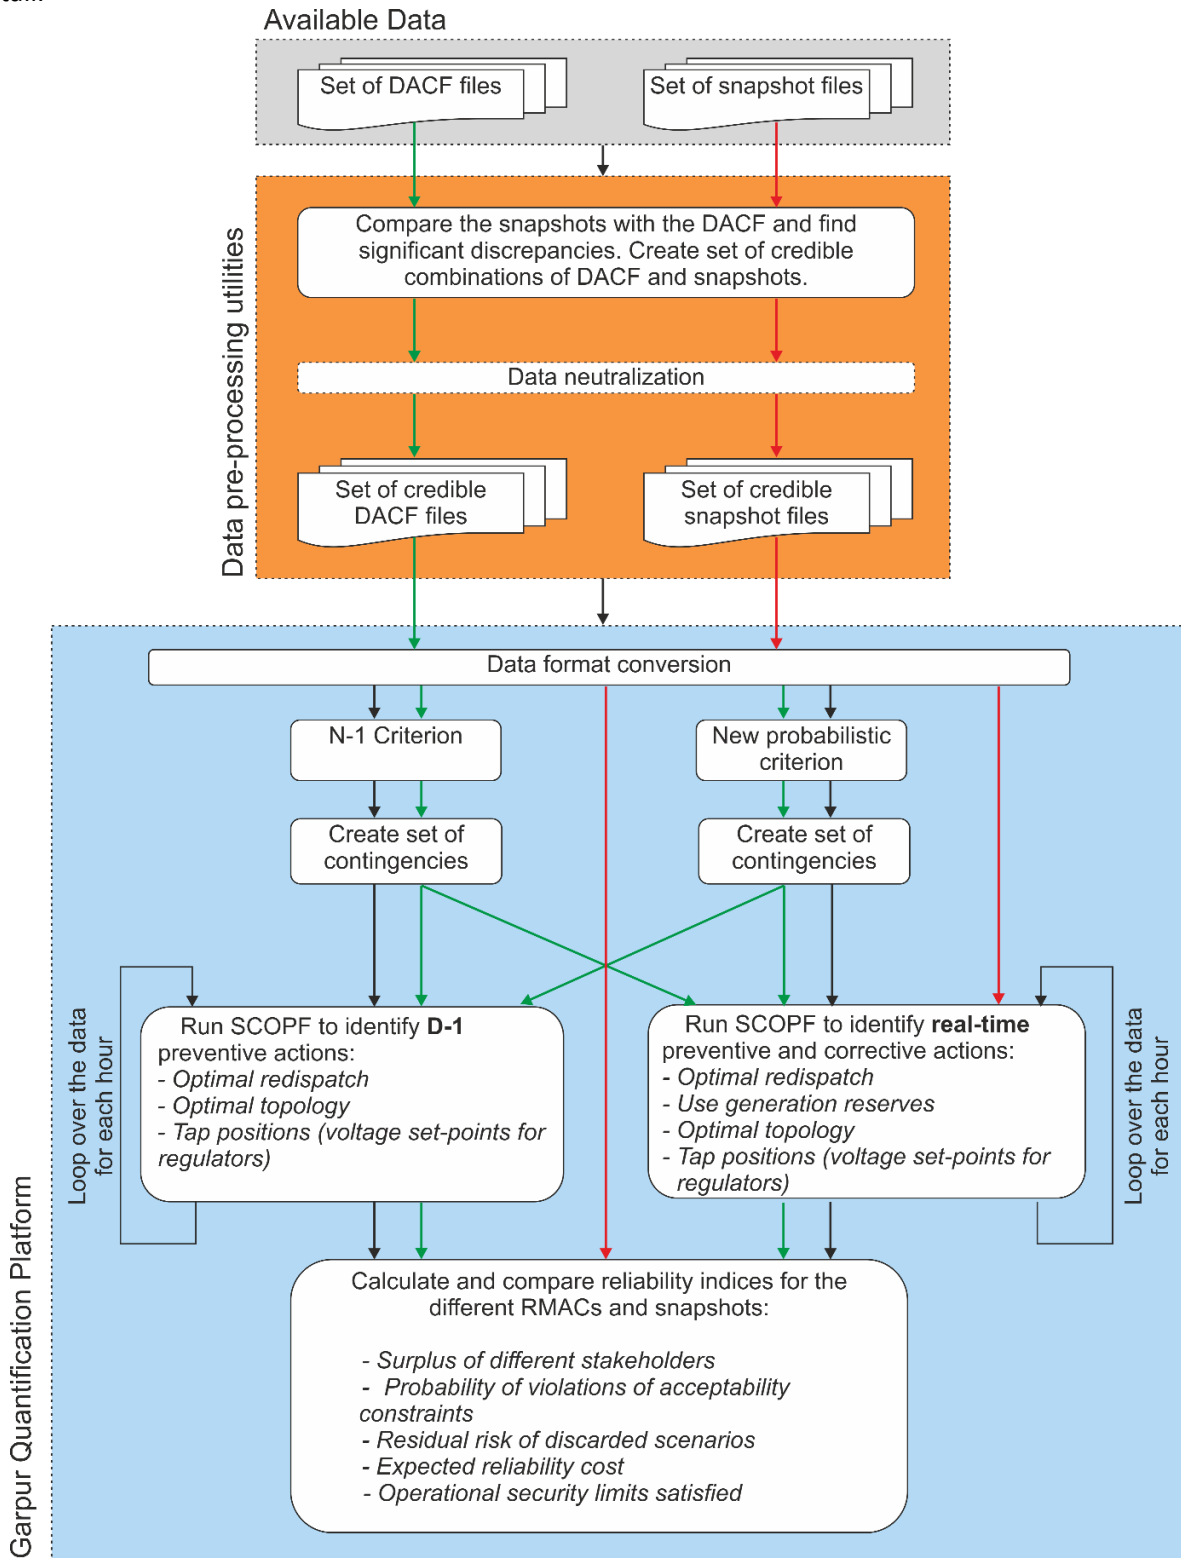


Figure 14. Workflow diagram for ESO’s pilot test

6.2.1 Available data

The available data consists of DACF files and snapshots with real measurements from the SCADA system. This is the data exchanged between TSOs for planning purposes.

6.2.2 Data pre-processing utilities

This section of blocks in the diagram is specific for ESO. The first block compares the data in the DACF files with the measurements in the snapshot files. If the algorithm finds big discrepancies between the data in the files then they are discarded. This is required since sometimes due to communication problems the data from the SCADA system is not reliable and if used it will lead to very unrealistic results. Also, if such compromised data is used to analyze the uncertainties, the estimation could be over pessimistic.

Another step for pre-processing the data could be neutralizing the data from the N-1 decisions taken from ESO.

After the pre-processing stage a set of credible DACF and snapshot files will be created. The data should include several representative days during different seasons of the year.

6.2.3 Simulations with GARPUR's Quantification Platform

First, the data files will be converted from UCTE to MATPOWER format, [Zimmerman et al., 2009], [Zimmerman et al., 2011].

The GQP should be capable of executing a security-constrained optimal power flow (SCOPF) for day-ahead (D-1) planning for both the N-1 and the new probabilistic criterion. Before the optimization a list of credible contingencies will be made. The optimization will be solved for each hour of the representative days and the results will be the optimal redispatch, topology and tap changer positions. The results from the different criteria will be evaluated and the reliability indices (see section 5.1.4) will be compared and analyzed.

The day-ahead optimization results will also be the basis for real-time simulations. The snapshot data will be used as the realization of the uncertainties (the deviation from the forecasts) and accordingly corrective actions will be decided with the help of SCOPF. Again, the N-1 and the probabilistic decisions will be compared in terms of the five reliability indices.

7 REFERENCES

- [Efla, 2015] Efla, "kostnaður vegna raforkuskorts tölur til notkunar árin 2015 og 2016", Efla Consulting, 2015.
- [ENSTO-E, 2014] ENSTO-E, Scenario Outlook and Adequacy Forecast (SO&AF) 2014-2030, 2014. Available at <https://www.entsoe.eu/major-projects/ten-year-network-development-plan/tyndp-2014/Pages/default.aspx>
- [GARPUR, 2013] GARPUR Consortium, GARPUR – Generally Accepted Reliability Principle with Uncertainty modelling and through probabilistic Risk assessment 2013, EU Commission.
- [GARPUR, 2014a] GARPUR Consortium, "State of the art on reliability assessment in power systems", 7th framework programme, EU Commission grant agreement 608540, 2014.
- [GARPUR, 2014b] GARPUR Consortium, "Current practices, drivers and barriers for new reliability standards", 7th framework programme, EU Commission grant agreement 608540, 2014.
- [GARPUR, 2015a] GARPUR Consortium. "Functional analysis of System Development process", 7th framework programme, EU Commission grant agreement 608540, 2015.
- [GARPUR, 2016] GARPUR Consortium. "Quantification method in the absence of market response and with market response taken into account", 7th framework programme, EU Commission grant agreement 608540, 2016, to be published.
- [Karangelos et al., 2016] E. Karangelos and L. Wehenkel, "Probabilistic Reliability Management Approach and Criteria for Power System Real-time Operation", Accepted for presentation at 19th Power Systems Computation Conference.
- [Zimmerman et al., 2009] R. D. Zimmerman, C. E. Murillo-Sánchez, and R. J. Thomas, "MATPOWER's Extensible Optimal Power Flow Architecture," Power and Energy Society General Meeting, 2009 IEEE, pp. 1-7, July 26-30 2009.
- [Zimmerman et al., 2011] R. D. Zimmerman, C. E. Murillo-Sánchez, and R. J. Thomas, "MATPOWER Steady-State Operations, Planning and Analysis Tools for Power Systems Research and Education," Power Systems, IEEE Transactions on, vol. 26, no. 1, pp. 12-19, Feb. 2011.